

- 1. THESE FOOTINGS ARE SUITABLE FOR MOUNTING HEIGHTS UP TO 12M AND SINGLE OR DOUBLE OUTREACHES UP TO 4.5M.
- 2. LUMINAIRE WIND AREA 0.2M<sup>2</sup>.
- 3. CONCRETE TO BE GRADE N32.
- 4. REINFORCEMENT BARS SHALL BE D500N IN ACCORDANCE WITH AS/NZS 4671. STANDARD HOOKS AND BENDS SHALL BE IN ACCORDANCE WITH AS 3600.
- MIN. COVER SHALL BE 75MM UNLESS OTHERWISE SHOWN.
- 5. CONCRETE SURROUND SHALL BE FINISHED BELOW THE VENT HOLES IN THE SLIP BASE FOOTINGS UNIT. CONCRETE INSIDE FOOTING UNIT TO BE DISHED DOWN BY NOMINAL 25MM TO THE BOTTOM OF CONDUIT DRAIN HOLES AND BE OF SMOOTH FINISH. CONCRETE SURROUND NOT TO BE COVERED BY BACK FILL.
- 6. REFER TO DPTI STANDARD DRAWINGS FOR PIT INSTALLATION.
  - 7. ALL DIMENSIONS SHOWN IN MM.

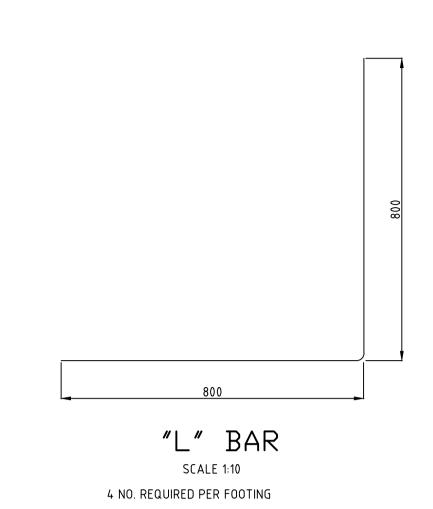

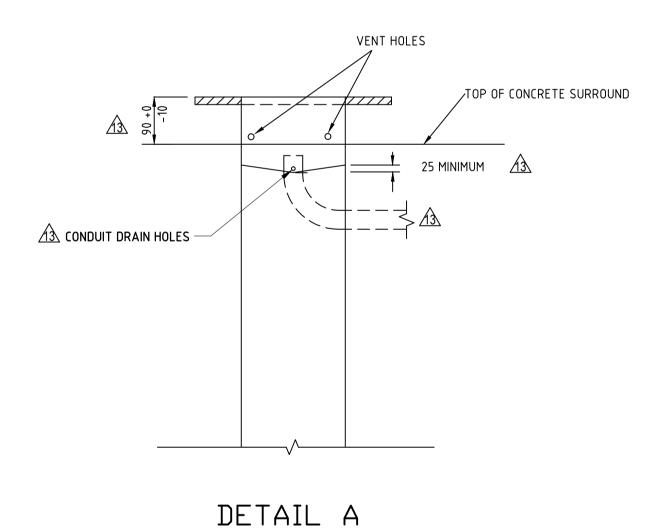



FOOTING UNIT INSTALLATION-TYPICAL


REFER TO NOTES THIS SHEET

100 MILLIMETRES ON ORIGINAL DRAWING

l									
<u>/13</u>	NOTE 5 ADDED. DIMENSION ALTERED.	28.11.15				5/4/16	S. PASCALE		
12	CONCRETE & REINFORCEMENT NOTE AMENDED	30.04.08	AP	P. MOLLOY		05.05.08	P. WILSON		
11	FORMED JUNCTION PIT DETAIL REMOVED. BASE ORIENTATION CHANGED	18.10.04	LM	W LEACH		12.11.04	R BURT		
10	BASE ORIENTATION CHANGED	20.8.03	C.E.	R.J.B.			R.J.BASSETT 20.8.03		
<u></u>	DETAIL A ADDED	3.09.01	C.E.	R.J.B.			R.J.BASSETT 3.09.01		
8	DRAWING REDRAWN IN DIFFERENT FORMAT	6.3.01	C.E.	R.J.B.			R.J.BASSETT 6.3.01		
<u> </u>	DIMENSION 125MM ALTERED TO CENTRE OF FOOTING UNIT	9.1.95	R.D.	R.J.B.			R.J.BASSETT 1,2,95		
6	DIMENSION CHANGED	5.8.93	A.P.	/					
5	NOTE ADDED	5.8.93	A.P.	αο-			RST		
4	POSITION OF DRAINAGE HOLE CHANGED	5.8.93	A.P.	V=G1			NINGHUR 8,93		
3	COVER ADDED	5.8.93	A.P.	ECH, 6.8			⊣၈		
2	DIMENSIONS ADDED	5.8.93	A.P.	N' >			D'BIII		
1	BAR SHAPE AND NUMBER REQUIRED CHANGED	5.8.93	A.P.						
NO.	DESCRIPTION		RESP	AUTHORISED	TCD AMENDTS APPROVED FOR C OF H	DATE	TECH. DETAILS APPROVED FOR C OF H	CONSTRUCTED DATE	
	AMENDMENTS I I I I I I I I I I I I I I I I I I I								

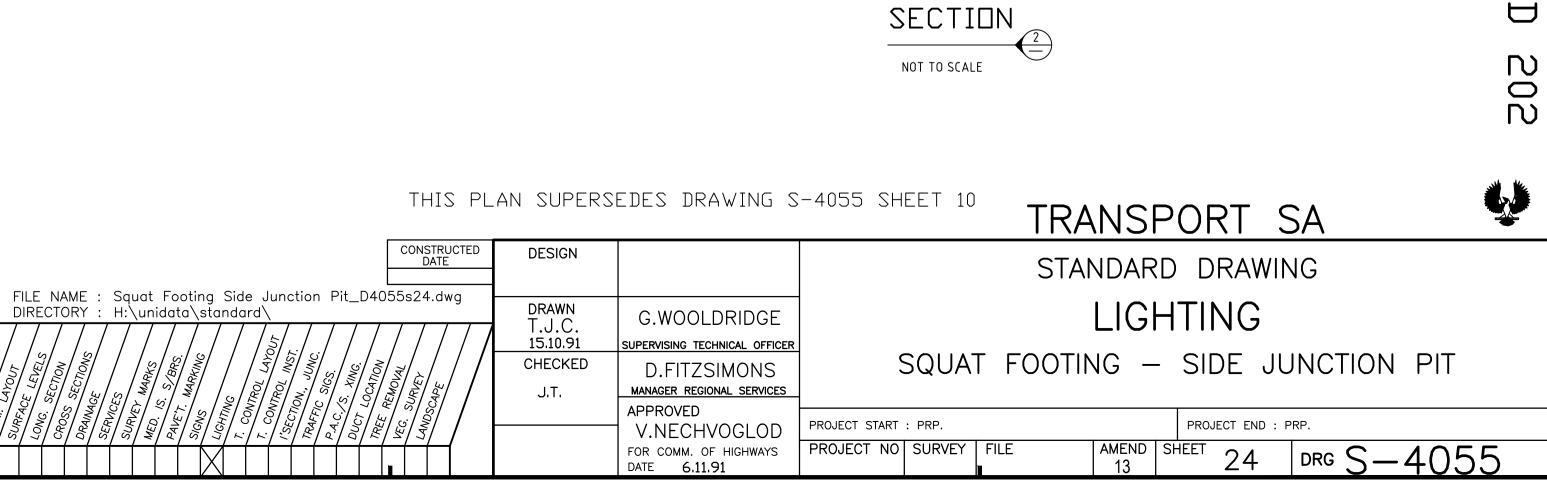

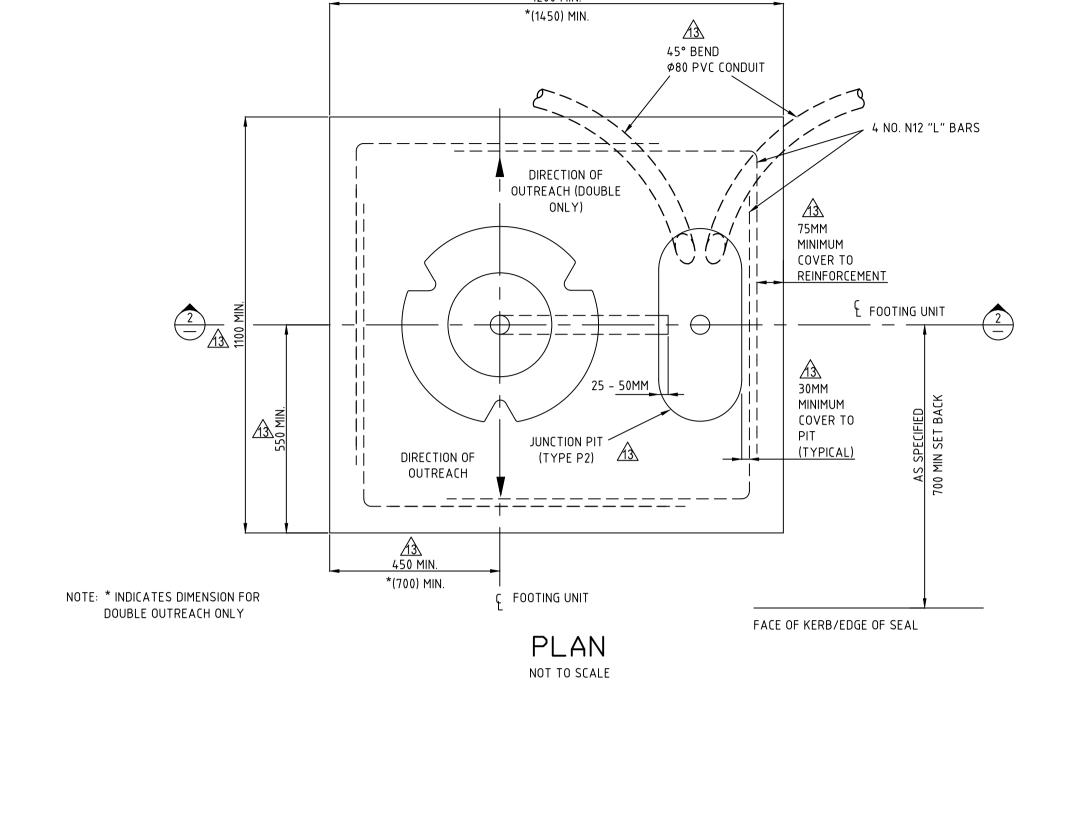

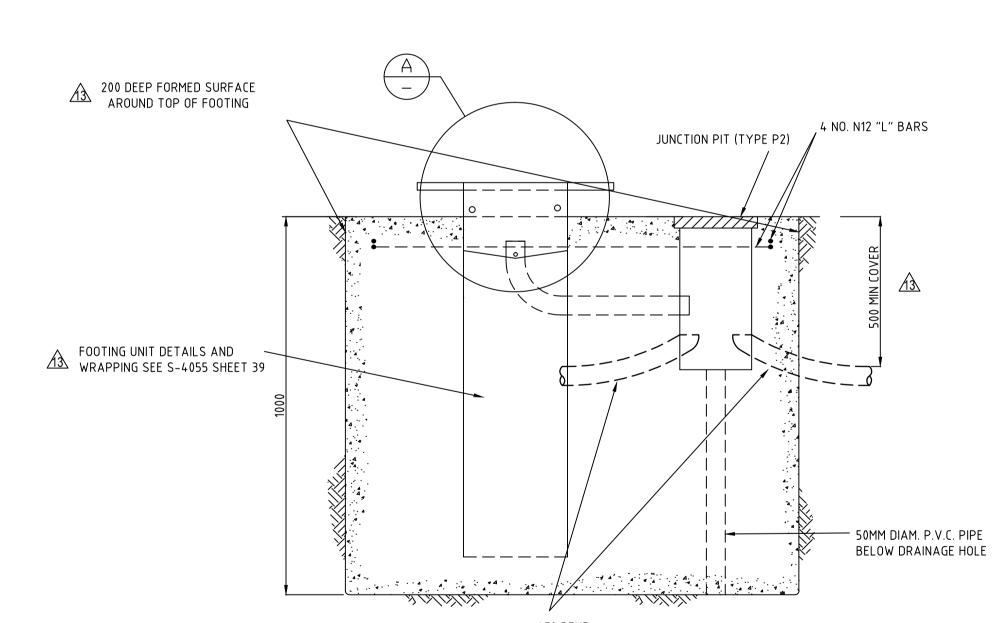

45° BEND Ø80 PVC CONDUIT SECTION