

## APPLICATION ON NOTIFICATION – ELECTRICITY INFRASTRUCTURE

<b>Type of development:</b>	SECTION 49A - Electricity Infrastructure
<b>Development Number:</b>	422/V004/19
<b>Applicant:</b>	ElectraNet Pty Ltd
<b>Nature of Development:</b>	Expansion of the existing Robertstown substation comprising: (a) extension of the existing substation footprint; (b) installation of two synchronous condensers contained within separate buildings and associated electrical infrastructure (including transformers, firewalls and gantries), second access road, perimeter fencing, drainage (and levy bank) and civil works; and (c) modifications to an existing high-voltage transmission line (with the installation of three new lattice towers and realignment works).
<b>Subject Land:</b>	Lower Bright Road, Bright
<b>Development Plan:</b>	Goyder Council Development Plan
<b>Zone / Policy Area:</b>	Primary Production Zone
<b>Contact Officer:</b>	Simon Neldner
<b>Phone Number:</b>	08 7109 7058
<b>Consultation Start Date:</b>	24 July 2019
<b>Consultation Close Date:</b>	21 August 2019
<p><b>During the notification period, hard copies of the application documentation can be viewed at the Department of Planning, Transport and Infrastructure, Level 5, 50 Flinders St, Adelaide, during normal business hours. Application documentation may also be viewed during normal business hours at the local Council office (if identified on the public notice).</b></p>	

Written representations must be received by the close date (indicated above) and can either be posted, hand-delivered, or emailed to the State Commission Assessment Panel (SCAP). A representation form is provided as part of this document.

**Any representations received after the close date will not be considered.**

Postal Address:

The Secretary  
State Commission Assessment Panel  
GPO Box 1815  
ADELAIDE SA 5001

Street Address:

Planning and Land Use Services  
Department of Planning, Transport and Infrastructure  
Level 5, 50 Flinders Street  
ADELAIDE

Email Address: [scapreps@sa.gov.au](mailto:scapreps@sa.gov.au)

**DEVELOPMENT ACT, 1993  
S49A – ELECTRICITY INFRASTRUCTURE  
REPRESENTATION ON APPLICATION**

**Applicant:** ElectraNet Pty Ltd  
**Development Number:** 422/V004/19  
**Nature of Development:** Expansion of the existing Robertstown substation  
**Zone / Policy Area:** Primary Production Zone (Goyder Council Development Plan)  
**Subject Land:** Lower Bright Road, Bright  
**Contact Officer:** Simon Neldner  
**Phone Number:** 08 7109 7058  
**Close Date:** 21 August 2019

My Name: \_\_\_\_\_ My phone number: \_\_\_\_\_

Primary method(s) of contact: \_\_\_\_\_ Email: \_\_\_\_\_  
Postal Address: \_\_\_\_\_ Postcode: \_\_\_\_\_

**You may be contacted via your nominated PRIMARY METHOD(s) OF CONTACT if you indicate below that you wish to be heard by the State Commission Assessment Panel in support of your submission.**

My interests are:  
(please tick one)

☐ owner of local property

☐ occupier of local property

☐ a representative of a company/other organisation affected by the proposal

☐ a private citizen

**The address of the property affected is:**

\_\_\_\_\_  
Postcode \_\_\_\_\_

My interests are:  
(please tick one)

☐ I support the development

☐ I support the development with some concerns

☐ I oppose the development

**The specific aspects of the application to which I make comment on are:** \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**I:** ☐ wish to be heard in support of my submission  
(please tick one) ☐ do not wish to be heard in support of my submission  
(Please tick one)

**By:** ☐ appearing personally  
(please tick one) ☐ being represented by the following person  
(Please tick one)

**Signature:** \_\_\_\_\_

**Date:** \_\_\_\_\_



## DEVELOPMENT ACT 1993

### READVERTISED

#### SECTION 49A - ELECTRICITY INFRASTRUCTURE

#### NOTICE OF APPLICATION FOR CONSENT TO DEVELOPMENT

Notice is hereby given that an application has been made by **ElectraNet Pty Ltd** for consent to the expansion of the existing Robertstown substation comprising: (a) extension of the existing substation footprint; (b) installation of two synchronous condensers contained within separate buildings and associated electrical infrastructure (including transformers, firewalls and gantries), second access road, perimeter fencing, drainage (and levy bank) and civil works; and (c) modifications to an existing highvoltage transmission line (with the installation of three new lattice towers and realignment works). **Development Application: 422/V004/19**

The subject land is located on Lower Bright Road, Bright and comprises a south-westerly extension to the existing Robertstown substation (a50, DP51338: CT 5689/927; and a51, DP51338: CT 5689/928) and the modification to an existing transmission line on adjacent land (s42, Hundred Plan 200300: CT 5464/828) and across the expanded substation site (identified above).

The development site is located within the Primary Production Zone of the Goyder Council Development Plan (Consolidated 24 November 2016).

The application may be examined during normal office hours at the office of the State Commission Assessment Panel, Level 5, 50 Flinders Street, Adelaide and at the principal office of the Regional Council of Goyder, 1 Market Square, Burra. Application documentation may also be viewed on the SCAP website:

[https://www.saplanningportal.sa.gov.au/public\\_notices](https://www.saplanningportal.sa.gov.au/public_notices)

Any person or body who desires to do so may make representations concerning the application by notice in writing delivered to the Secretary, State Commission Assessment Panel, GPO Box 1815, Adelaide 5001

**NOT LATER THAN FRIDAY 21 AUGUST 2019.**

Submissions may also be made via email to [scapreps@sa.gov.au](mailto:scapreps@sa.gov.au)

Each person or body making a representation should state the reason for the representation and whether that person or body wishes to be given the opportunity to appear before the SCAP to further explain the representation.

Submissions may be made available for public inspection.

Should you wish to discuss the application and the public notification procedure please contact **Simon Neldner** on **08 7109 7058**.

Alison Gill

**SECRETARY**

**STATE COMMISSION ASSESSMENT PANEL**

PN3953

[www.sa.gov.au](http://www.sa.gov.au)

PN3953

25x2 (63mm)

Adelaide Advertiser

River News, Barossa Light Herald

Wednesday 24 July 2019

**APPROVAL REQUIRED BY 10AM FRIDAY 19 JULY 2019**

# SECTION 49 & 49A – CROWN DEVELOPMENT DEVELOPMENT APPLICATION FORM

PLEASE USE BLOCK LETTERS

COUNCIL: Goyder  
 APPLICANT: ElectraNet Pty Ltd  
 ADDRESS: 52-55 East Tce, Adelaide 5000  
 CROWN AGENCY: ElectraNet Pty Ltd

FOR OFFICE USE

DEVELOPMENT No: \_\_\_\_\_  
 PREVIOUS DEVELOPMENT No: \_\_\_\_\_  
 DATE RECEIVED:     /     /

## CONTACT PERSON FOR FURTHER INFORMATION

Name: Scott Haynes  
 Telephone: 0408883559 [work] \_\_\_\_\_ [Ah]  
 Fax: \_\_\_\_\_ [work] \_\_\_\_\_ [Ah]  
 Email: haynes.scott@electranet.com.au

### NOTE TO APPLICANTS:

(1) All sections of this form must be completed. The site of the development must be accurately identified and the nature of the proposal adequately described. If the expected development cost of this Section 49 or Section 49A application exceeds \$100,000 (excl. fit-out) or the development involves the division of land (with the creation of additional allotments) it will be subject to those fees as outlined in Item 1 of Schedule 6 of the *Development Regulations 2008*. Proposals over \$4 million (excl. fit-out) will be subject to public notification and advertising fees.  
 (2) Three copies of the application should also be provided.

- ☐ Complying  
☐ Merit  
☐ Public Notification  
☐ Referrals

Decision: \_\_\_\_\_  
 Type: \_\_\_\_\_  
 Finalised:     /     /

	Decision required	Fees	Receipt No	Date
Planning:	_____	_____	_____	_____
Land Division:	_____	_____	_____	_____
Additional:	_____	_____	_____	_____
<b>Minister's Approval</b>	_____	_____	_____	_____

EXISTING USE: Substation / Grazing land

DESCRIPTION OF PROPOSED DEVELOPMENT: Substation expansion for installation of two synchronous condensers, four additional diameters and associated transmission line alterations requiring installation of three new structures

LOCATION OF PROPOSED DEVELOPMENT: Robertstown Substation

House No: _____	Lot No: _____	Street: <u>Lower Bright Road</u>	Town/Suburb: <u>Robertstown</u>
Section No [full/part] <u>Lot 50</u>	Hundred: <u>Bright</u>	Volume: <u>5689</u>	Folio: <u>927</u>
Section No [full/part] <u>Lot 51</u>	Hundred: <u>Bright</u>	Volume: <u>5689</u>	Folio: <u>928</u>
LAND DIVISION: <u>Lot 42</u>	Hundred: <u>Bright</u>	Volume: <u>5464</u>	Folio: <u>828</u>

Site Area [m<sup>2</sup>] \_\_\_\_\_ Reserve Area [m<sup>2</sup>] \_\_\_\_\_ No of existing allotments \_\_\_\_\_  
 Number of additional allotments [excluding road and reserve]: \_\_\_\_\_ Lease: YES ☐ NO ☐

DEVELOPMENT COST [do not include any fit-out costs]: \$ 30,500,000

**POWERLINE SETBACKS:** Pursuant to Schedule 5 (2a)(1) of the *Development Regulations 2008*, if this application is for a building it will be forwarded to the Office of the Technical Regulator for comment unless the applicant provides a declaration to confirm that the building meets the required setback distances from existing powerlines. The declaration form and further information on electricity infrastructure and clearance distances can be downloaded from the DPLG website ([www.dac.sa.gov.au](http://www.dac.sa.gov.au)).

I acknowledge that copies of this application and supporting documentation may be provided to interested persons in accordance with the *Development Act 1993*.

SIGNATURE: \_\_\_\_\_

Dated: 06 / 06 / 2019



# Robertstown Substation Expansion

Development Application for Substation Expansion, Synchronous Condensers and Transmission line realignment

June 2019

Version 0

Security Classification: Public



## ElectraNet Corporate Headquarters

52-55 East Terrace, Adelaide, South Australia 5000 • PO Box 7096, Hutt Street Post Office, Adelaide, South Australia 5000  
Tel: (08) 8404 7966 • Fax: (08) 8404 7956 • Toll Free: 1800 243 853

## Copyright and Disclaimer

Copyright in this material is owned by or licensed to ElectraNet. Permission to publish, modify, commercialise or alter this material must be sought directly from ElectraNet.

Reasonable endeavours have been used to ensure that the information contained in this report is accurate at the time of writing. However, ElectraNet gives no warranty and accepts no liability for any loss or damage incurred in reliance on this information.

Revision Record					
Date	Version	Description	Author	Checked By	Approved By
6/6/19	0	DA Report	S Haynes	C.Costan	D. Costan

## Contents

<b>1.</b>	<b>INTRODUCTION.....</b>	<b>5</b>
<b>2.</b>	<b>BACKGROUND .....</b>	<b>5</b>
2.1	PROJECT NEED .....	5
<b>3.</b>	<b>SUBJECT SITE.....</b>	<b>7</b>
3.1	LOCATION .....	7
3.2	PROPERTY .....	7
<b>4.</b>	<b>NATURE OF DEVELOPMENT .....</b>	<b>8</b>
4.1	SUBSTATION EXPANSION .....	8
4.2	SYNCHRONOUS CONDENSERS .....	10
4.2.1	<i>Typical configuration</i> .....	11
4.3	TRANSMISSION LINES .....	12
<b>5.</b>	<b>DEVELOPMENT ASSESSMENT.....</b>	<b>13</b>
<b>6.</b>	<b>RECOMMENDATION .....</b>	<b>13</b>
	<b>APPENDICES .....</b>	<b>14</b>
	<b>APPENDIX A CERTIFICATE OF TITLE.....</b>	<b>15</b>
	<b>APPENDIX B SUBSTATION DRAWINGS .....</b>	<b>26</b>
	<b>APPENDIX C TRANSMISSION LINE DRAWINGS .....</b>	<b>30</b>

## Figures

Figure 2-1: Role of ElectraNet in the electricity supply chain.....	5
Figure 3-1 Site location .....	7
Figure 4-1 Proposed substation layout.....	8
Figure 4-2 Robertstown Substation (current – view looking south west).....	9
Figure 4-3 Robertstown Substation (current - view looking north) .....	9
Figure 4-4 Robertstown Substation (current - view looking south east) .....	10
Figure 4-5 Synchronous Condenser Main Components (source: gagridsolutions.com).....	11

Figure 4-6 Example Synchronous Condensers .....11

Figure 4-7 New transmission line configuration .....12

## 1. Introduction


To facilitate the construction and installation of Synchronous Condensers to the electricity grid together with allowing for additional line exits, there is a need to expand the Robertstown Substation.

## 2. Background

ElectraNet Pty Ltd (ElectraNet) is the principal electricity Transmission Network Service Provider (TNSP) in South Australia, operating as part of the National Electricity Market under National Electricity Rules. The company's revenue is set by the Australian Energy Regulator (AER).

ElectraNet's role is to own and manage the high-voltage transmission lines and substations that connect this State's electricity generation system to multiple customer connection points, including SA Power Network's lower-voltage distribution network. The role of ElectraNet in the electricity supply chain is shown in Figure 2-1:

### How electricity gets to you

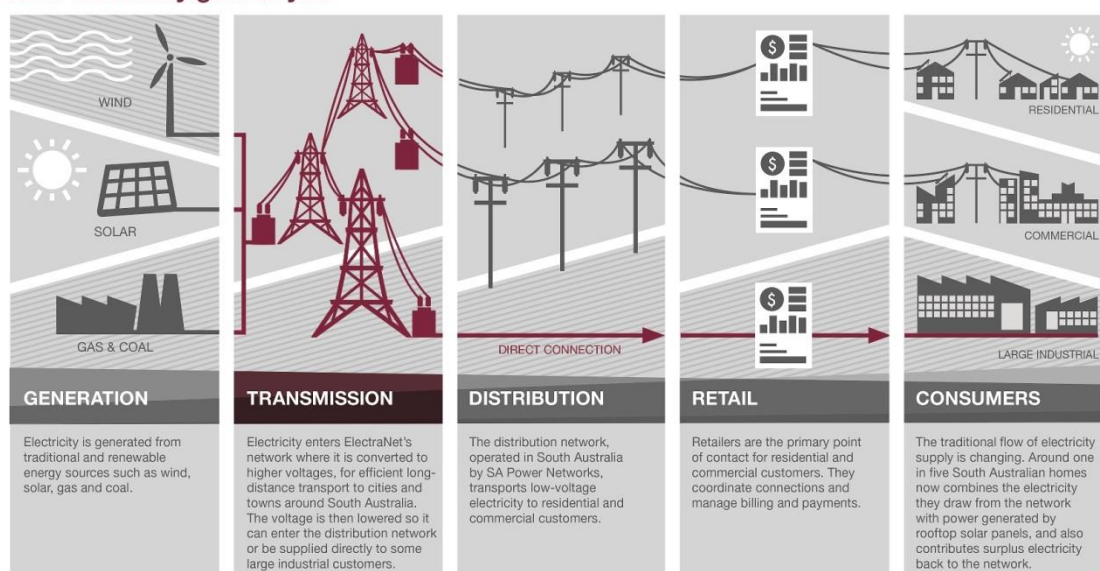

**Figure 2-1: Role of ElectraNet in the electricity supply chain**

ElectraNet's transmission network is one of the most extensive regional transmission systems in Australia, extending across some 200,000 square kilometres of the State. This network consists of transmission lines operating at 132,000 and 275,000 Volts, which are supported by both lattice towers and large stobie poles.

### 2.1 Project Need

South Australia has become a world leader in renewable energy generation. This means that traditional synchronous generation sources, such as gas-fired units, now operate less often.

A secure power system needs adequate levels of system strength and inertia, which to date have been provided by traditional synchronous generators.

To maintain and manage the security of the power system this traditional source of system strength now needs to be provided by other means. In October 2017, the Australian Energy Market Operator (AEMO) declared a gap in system strength in South Australia, which requires ElectraNet to use its reasonable endeavours to address this gap on an ongoing basis.

AEMO's notice identified a system strength gap at the Davenport 275 kV transmission connection point of 620 MVA each year for the remainder of the current five-year NSCAS planning horizon and beyond.

System strength relates to the ability of a power system to manage minor fluctuations in supply or demand while maintaining stable voltage levels, ensuring stable and secure supply for customers. A lack of system strength on the power system brings with it an increased risk of system instability and supply interruptions.

ElectraNet has been investigating options to address this gap to ensure we can provide customers with a reliable and secure power system, while also keeping costs down. Options include entering into contracts with generators or installing synchronous condensers.

Following an analysis of these options through a generator tendering process and advice from independent energy market experts, the installation of synchronous condensers on the network has been determined to be the most efficient and least cost option.

Synchronous Condensers can provide some very strong system benefits that offer great value to the operation of the grid:

- Increase in Short-Circuit Strength: Synchronous Condensers are the only technology that significantly increases fault current.
- Increase in System Inertia: Synchronous Condensers are the only technology that increases system inertia which benefits frequency stabilization.

The implementation of a synchronous condenser solution has the support of AEMO, the AER and the South Australian Government. It is expected to be fully operational by the end of 2020.

Network analysis by ElectraNet has determined that synchronous condensers should be connected at Davenport (near Port Augusta), Robertstown (in mid north of South Australia) and potentially a metropolitan site in Adelaide.

In addition, with upcoming approved and proposed renewable generation and network projects in the vicinity of Robertstown substation, there is a need to extend the substation to provide ability for additional connection points.

This application is for the Robertstown site. A separate application for synchronous condensers at Davenport (DA 660/V002/19) has recently been approved.

### 3. Subject Site

#### 3.1 Location

Robertstown Substation is located approximately 6km north-east of the township of Robertstown in the Mid North of South Australia as shown in Figure 3-1.


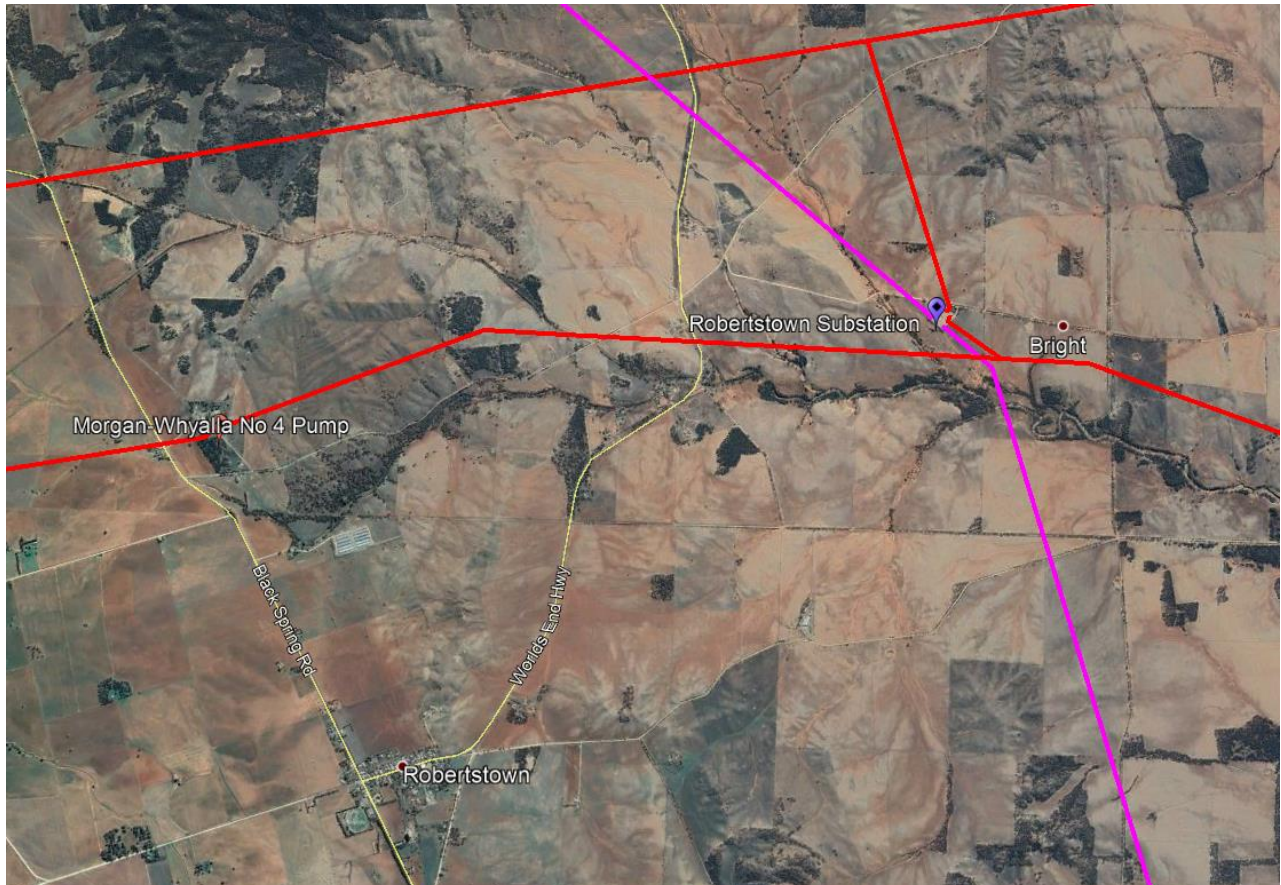


Figure 3-1 Site location

#### 3.2 Property

The subject property is defined as Allotment 50, Certificate of Title 5689/927 and Allotment 51, Certificate of Title 5689/928 (refer Appendix A). ElectraNet has recently purchased additional land from Allotment 51 and a boundary realignment to enlarge Allotment 50 is in process.



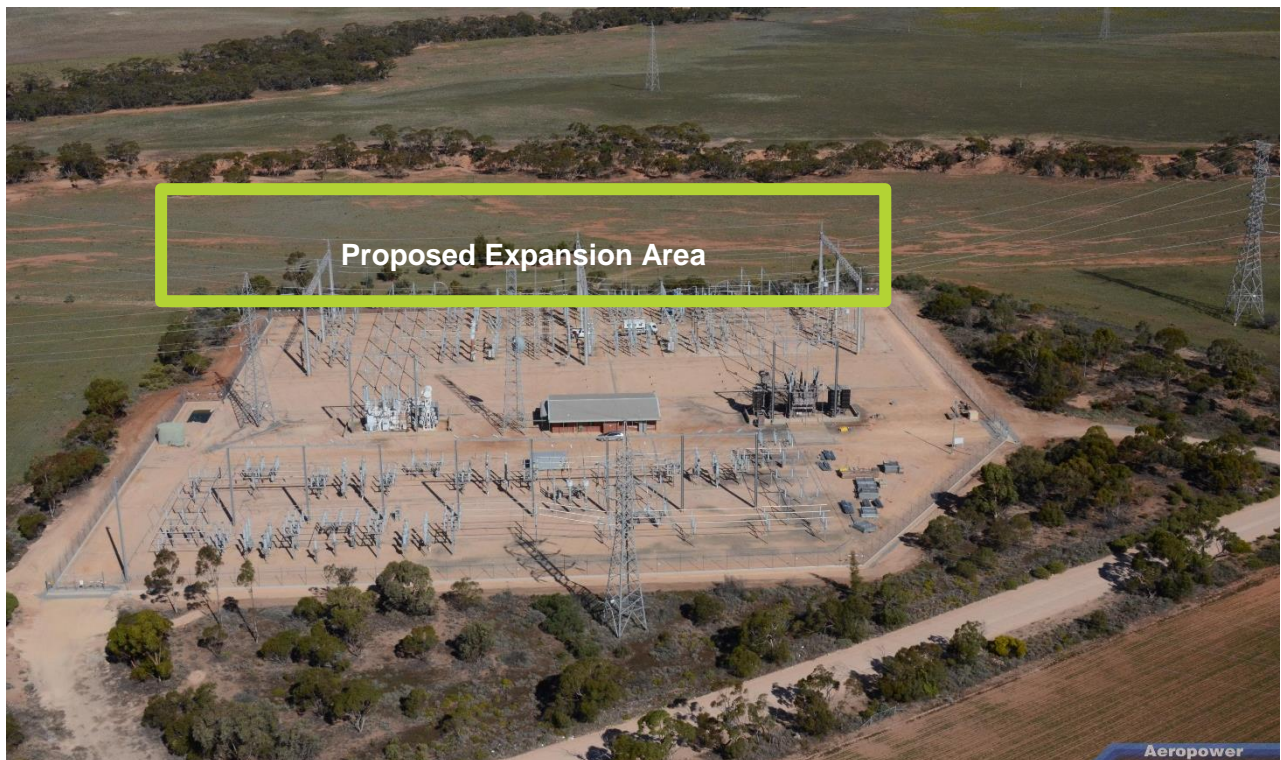

**Figure 4-2 Robertstown Substation (current – view looking south west)**



**Figure 4-3 Robertstown Substation (current - view looking north)**



Figure 4-4 Robertstown Substation (current - view looking south east)

## 4.2 Synchronous Condensers

The two synchronous condensers will be contained within separate buildings measuring approximately 32m x 23.5m x 11.5m high for weather protection. The buildings will be constructed using insulated colorbond sheet metal material in a neutral, low reflective colour.

“In electrical engineering, a synchronous condenser (sometimes called a synchronous capacitor or synchronous compensator) is a DC-excited synchronous motor, whose shaft is not connected to anything but spins freely. Its purpose is not to convert electric power to mechanical power or vice versa, but to adjust conditions on the electric power transmission grid. Its field is controlled by a voltage regulator to either generate or absorb reactive power as needed to adjust the grid's voltage, or to improve power factor. The condenser's installation and operation are identical to large electric motors and generators” (Wikipedia).

Each synchronous condenser (refer Figures 4-5 and 4-6) will have an associated new transformer, firewalls, gantries and associated electrical equipment to connect to the substation. Main Components



Figure 4-5 Synchronous Condenser Main Components (source: gegridsolutions.com)

#### 4.2.1 Typical configuration



Figure 4-6 Example Synchronous Condensers

### 4.3 Transmission lines

Some minor transmission line realignment external of the substation will be required to reconfigure certain diameters for line exits. This realignment will require construction of three (3) lattice towers or steel monopoles at locations as illustrated in Figure 4-7 and drawings in Appendix C.

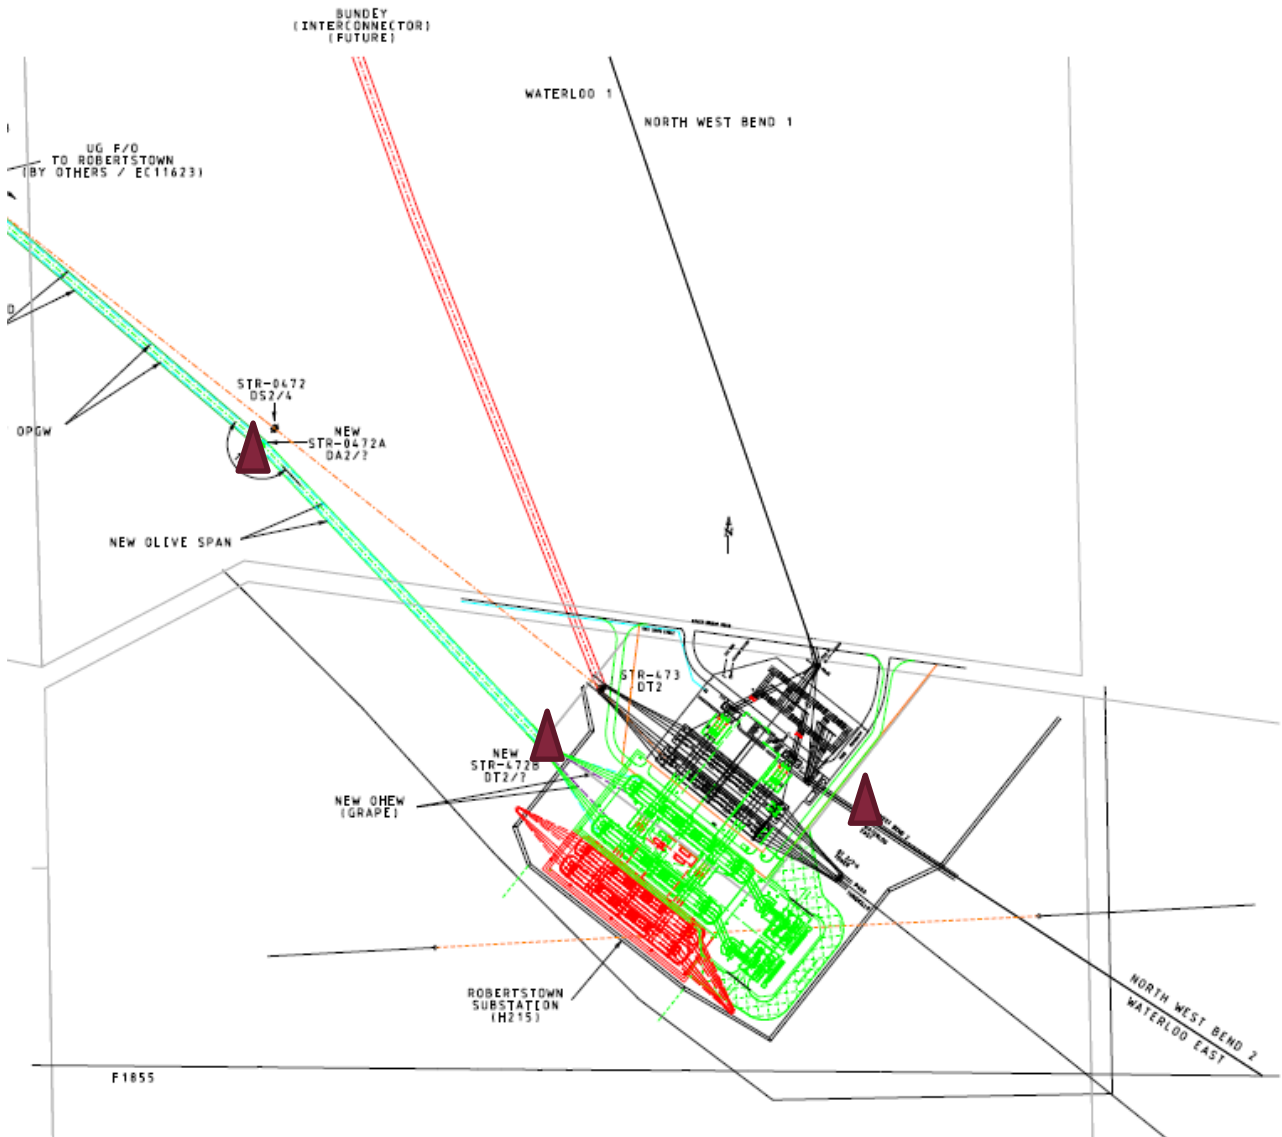


Figure 4-7 New transmission line configuration

## 5. Development Assessment

The Goyder Council Development Plan (Consolidated 24 November 2016) is the relevant plan for this proposal.

The subject site is located within the Primary Production Zone (Refer Maps Go/1). The proposed development will not affect any neighbouring property with the nearest dwelling some 900-1000m away to the north.

The proposed expansion of the substation is not at variance with the zone provisions and represents orderly development.

## 6. Recommendation

That the proposed development is granted Crown Development Approval pursuant to Section 49A being Electricity Infrastructure Development.




# Robertstown Substation Expansion

Appendices

June 2019

Security Classification: Public

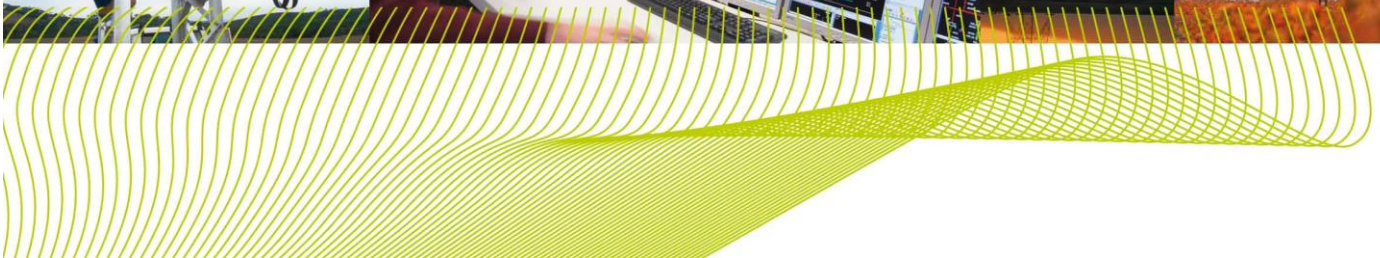

## Appendix A Certificate of Title

REAL PROPERTY ACT, 1886



The Registrar-General certifies that this Title Register Search displays the records maintained in the Register Book and other notations at the time of searching.



## Certificate of Title - Volume 5464 Folio 828

Parent Title(s) CT 4273/649

Creating Dealing(s) CONVERTED TITLE

Title Issued 30/10/1997 Edition 4 Edition Issued 13/12/2018

## Estate Type

FEE SIMPLE

## Registered Proprietor

STRODETO PTY. LTD. (ACN: 625 014 646)  
OF CARE 571 STOCK ROUTE ROAD ROBERTSTOWN SA 5381

## Description of Land

SECTION 42  
HUNDRED OF BRIGHT  
IN THE AREA NAMED BRIGHT

## Easements

SUBJECT TO EASEMENT(S) OVER THE LAND MARKED A TO THE ETSA CORPORATION (T 5079119)

## Schedule of Dealings

NIL

## Notations


Dealings Affecting Title NIL

Priority Notices NIL

Notations on Plan NIL

Registrar-General's Notes NIL

Administrative Interests NIL



REAL PROPERTY ACT, 1886



South Australia

The Registrar-General certifies that this Title Register Search displays the records maintained in the Register Book and other notations at the time of searching.



## Certificate of Title - Volume 5689 Folio 927

**Parent Title(s)** CT 4213/306, CT 5295/766, CT 5471/432

**Creating Dealing(s)** RTC 8696570

**Title Issued** 07/09/1999      **Edition** 3      **Edition Issued** 12/10/2001

## Estate Type

FEE SIMPLE

## Registered Proprietor

TRANSMISSION LESSOR CORPORATION  
OF 200 VICTORIA SQUARE ADELAIDE SA 5000

## Description of Land

ALLOTMENT 50 DEPOSITED PLAN 51338  
IN THE AREA NAMED BRIGHT  
HUNDRED OF BRIGHT

## Easements

NIL

## Schedule of Dealings

Dealing Number	Description
9061500	LEASE TO ELECTRANET PTY. LTD. COMMENCING ON 31/10/2000 AND EXPIRING ON 30/10/2200 PURSUANT TO ELECTRICITY CORPORATIONS (RESTRUCTURING AND DISPOSAL) ACT 1999

## Notations

**Dealings Affecting Title** NIL


**Priority Notices** NIL

**Notations on Plan** NIL

### Registrar-General's Notes

APPROVED D120572

**Administrative Interests** NIL

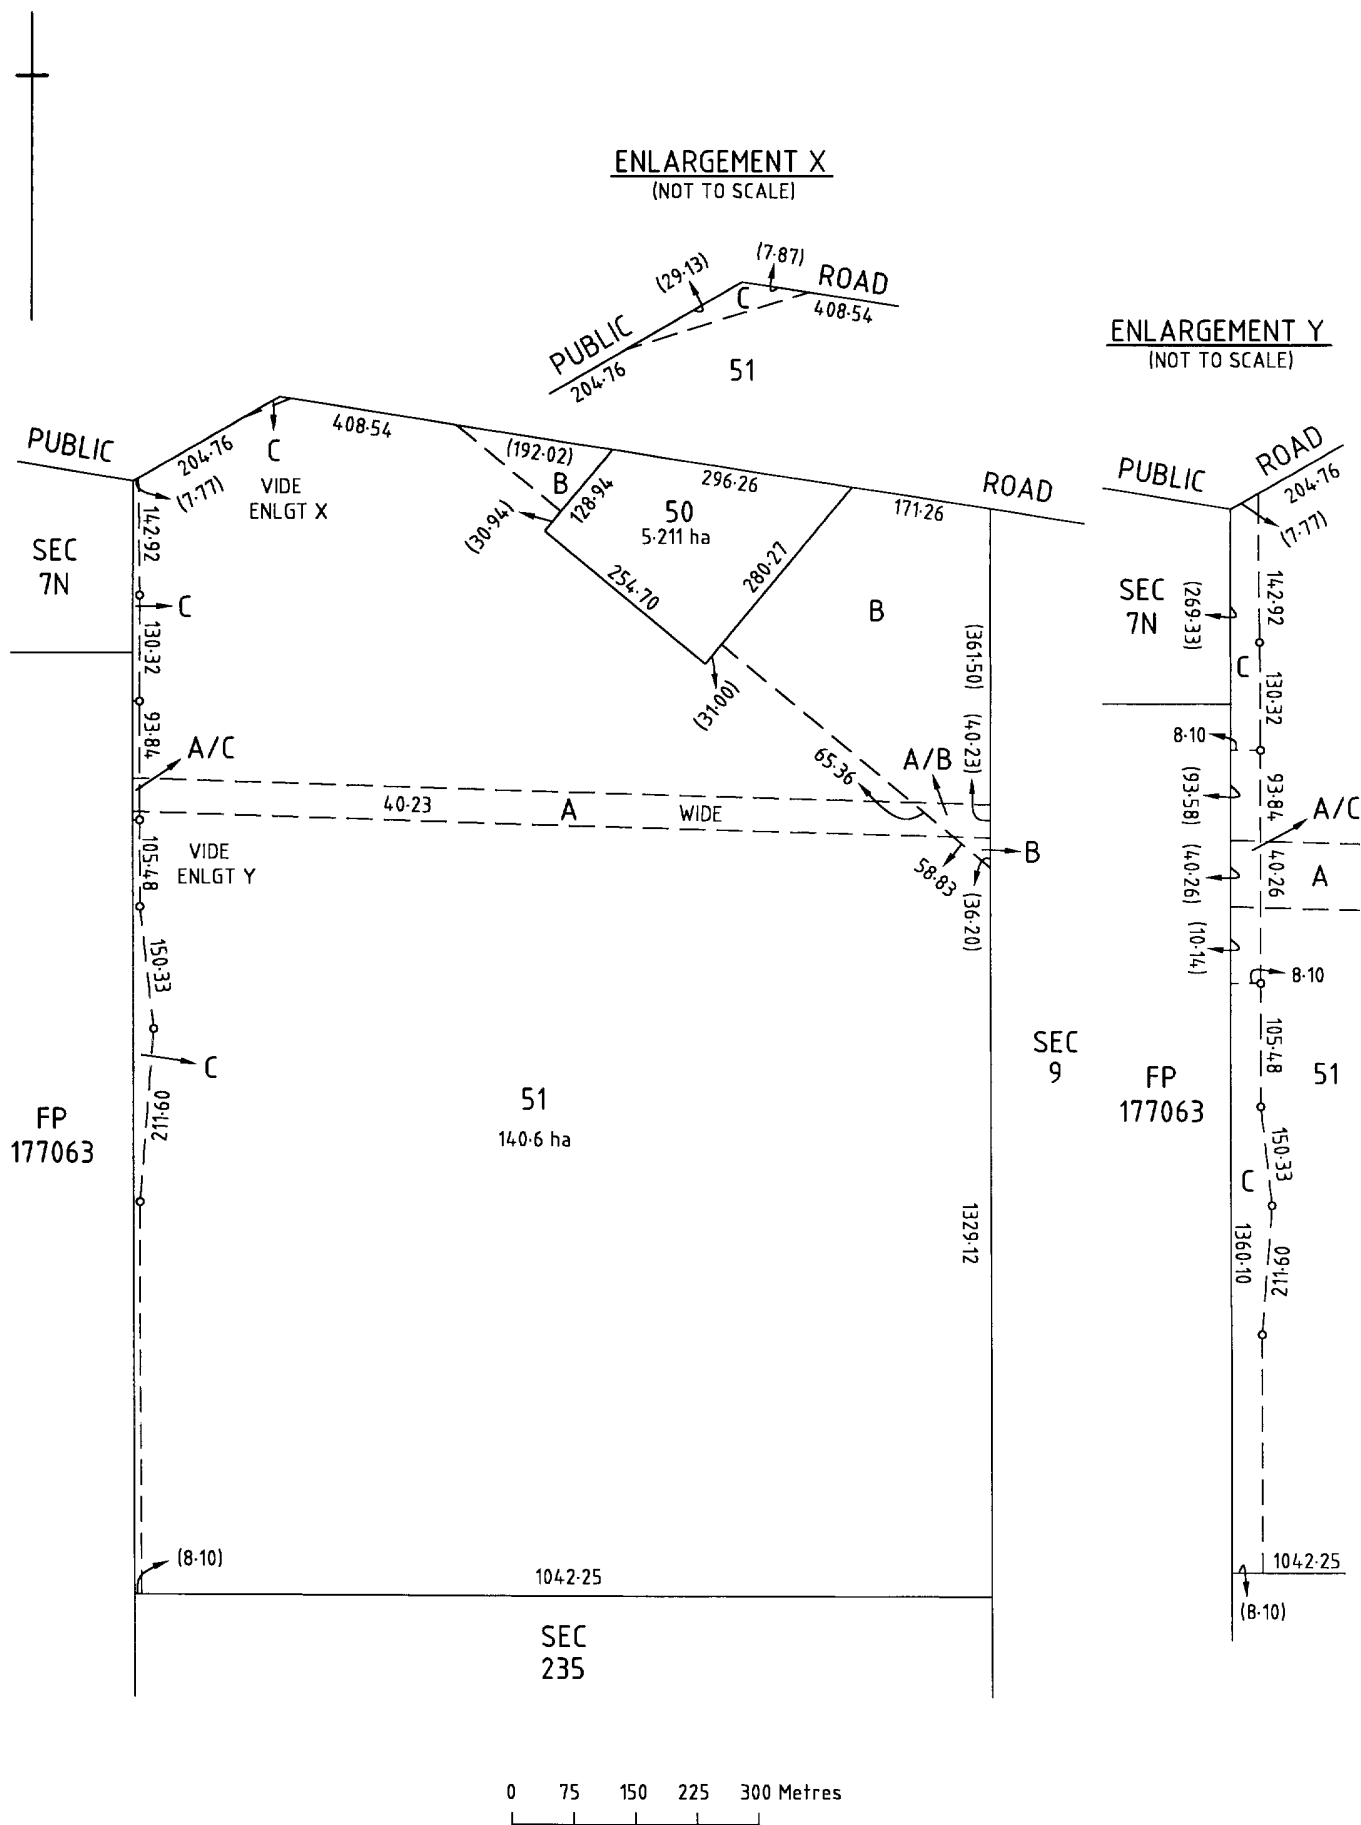

REAL PROPERTY ACT, 1886



The Registrar-General certifies that this Title Register Search displays the records maintained in the Register Book and other notations at the time of searching.



## Certificate of Title - Volume 5689 Folio 928

Parent Title(s)	CT 5295/766		
Creating Dealing(s)	RTC 8696570		
Title Issued	07/09/1999	Edition 2	Edition Issued 15/11/2001

## Estate Type

FEE SIMPLE

## Registered Proprietor

JOHN ROBERT LIPSCHINSKI  
OF ROBERTSTOWN SA 5381

## Description of Land

ALLOTMENT 51 DEPOSITED PLAN 51338  
IN THE AREA NAMED BRIGHT  
HUNDRED OF BRIGHT

## Easements

SUBJECT TO EASEMENT(S) OVER THE LAND MARKED A.B AND C TO THE ETSA CORPORATION (T 3030798 T 5085252 AND T 5276850 RESPECTIVELY)

## Schedule of Dealings

Dealing Number	Description
9211582	MORTGAGE TO WESTPAC BANKING CORPORATION
12650019	CAVEAT BY ENERGYAUSTRALIA HALLETT PTY. LTD. (ACN: 120 665 643) OVER PORTION (D IN F251560)


## Notations

Dealings Affecting Title	NIL
Priority Notices	NIL
Notations on Plan	NIL


### Registrar-General's Notes

APPROVED FX251560

Administrative Interests	NIL
--------------------------	-----

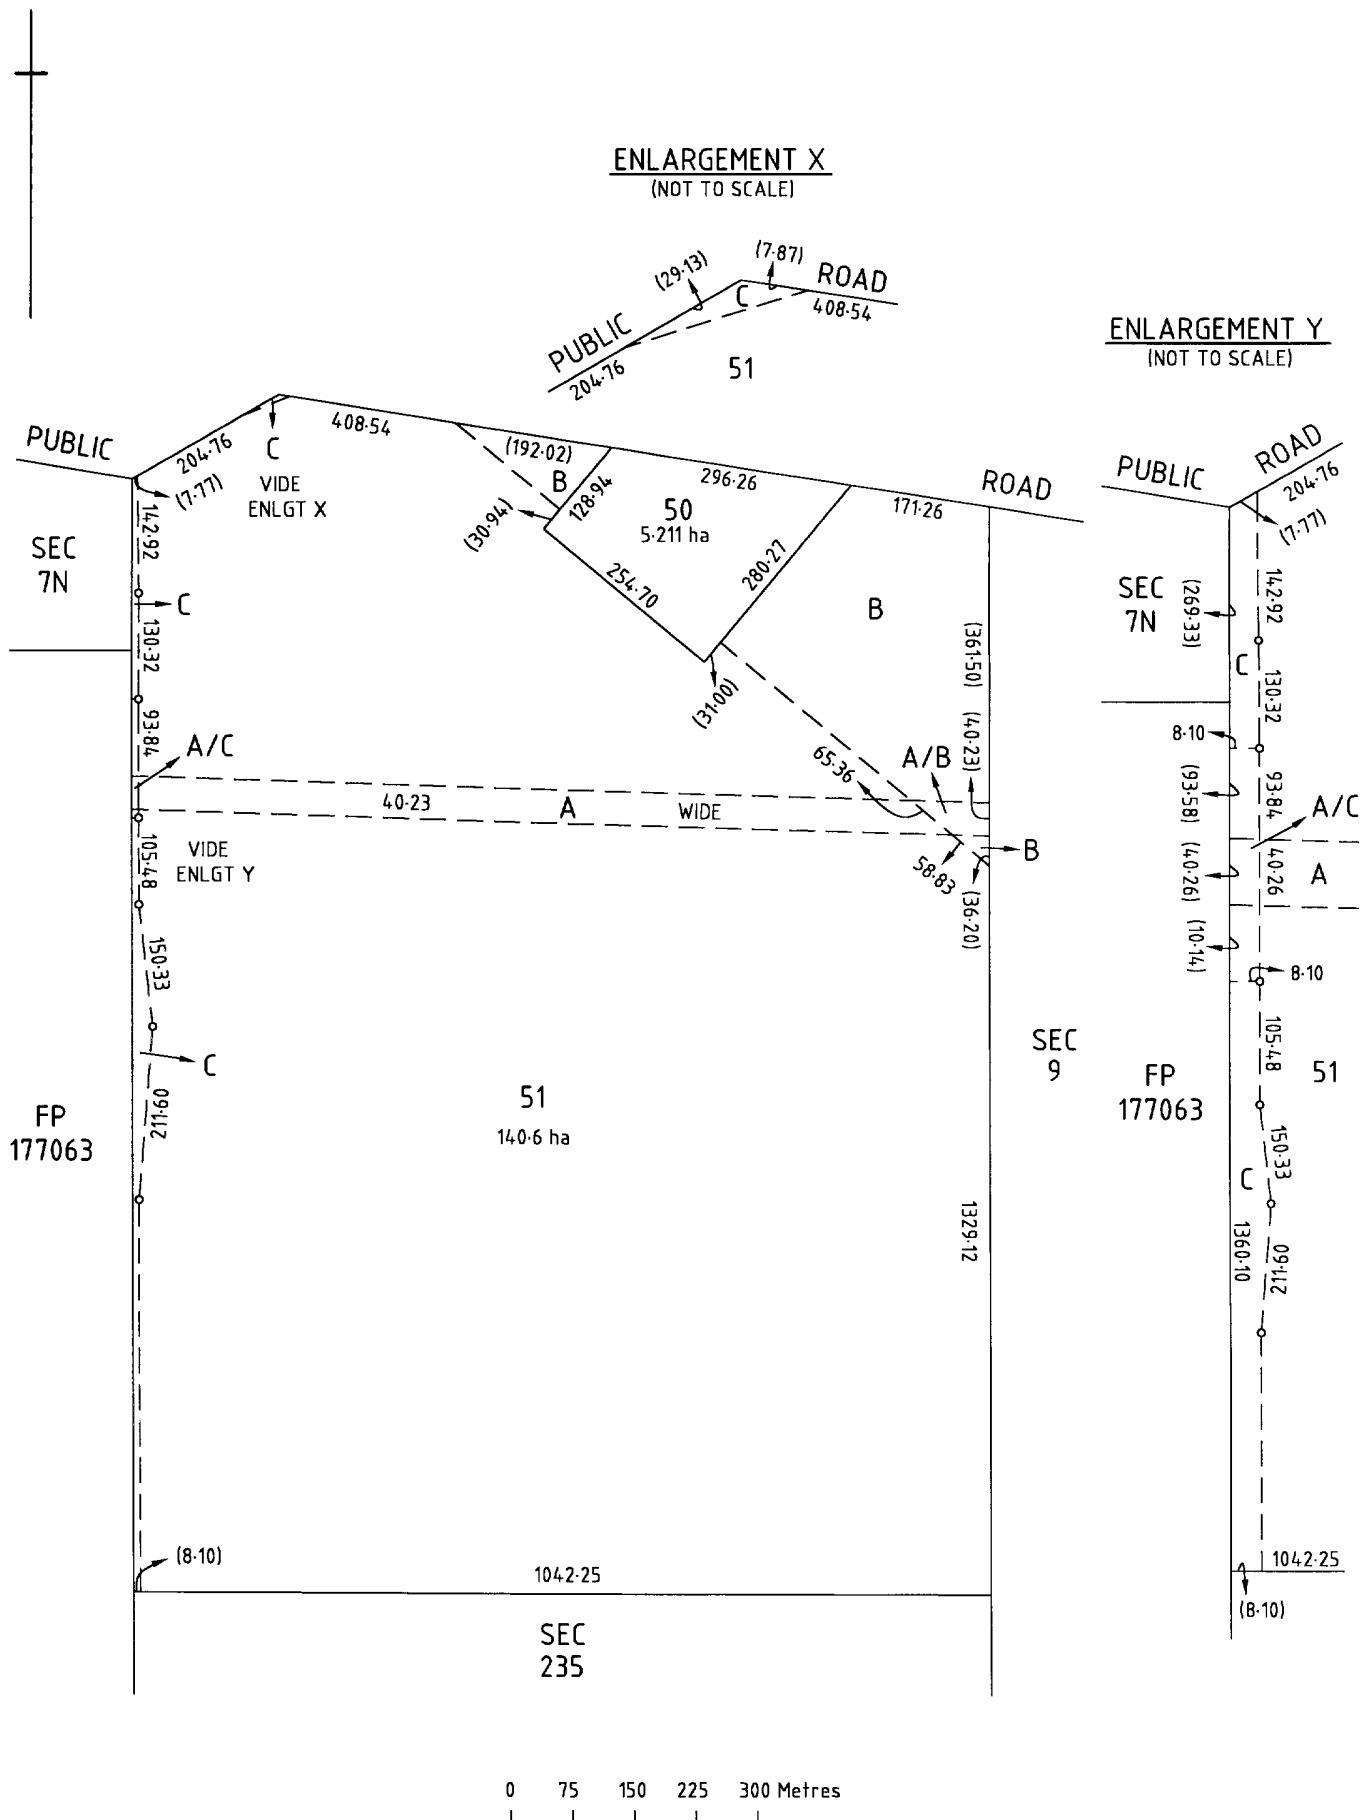

APPROVED - NOT YET DEPOSITED

PURPOSE:		DIVISION		AREA NAME:		BRIGHT		APPROVED:			
MAP REF:		6730/49/G, 6730/49/H, 6730/49/A, 6730/49/B		COUNCIL:		REGIONAL COUNCIL OF GOYDER		STELLA VAGENAS 25/02/2019		D120572	
LAST PLAN:				DEVELOPMENT NO:				DEPOSITED:			
										SHEET 1 OF 3	
										65154_text_01_v05_Version_5	

AGENT DETAILS:		ALEXANDER & SYMONDS PTY LTD 1ST FLOOR 11 KING WILLIAM ST KENT TOWN SA 5067 PH: 81301666 FAX: 83620099		SURVEYORS CERTIFICATION:		I DAMIAN JOHN HOLLAND , a licensed surveyor do hereby certify - 1) That this plan has been made from surveys carried out by me or under my personal supervision and in accordance with the Survey Act 1992. 2) That the field work was completed on the 24th day of October 2018 25th day of February 2019 Damian Holland Licensed Surveyor					
AGENT CODE:		ALSY									
REFERENCE:		A064518LTO(A)									

SUBJECT TITLE DETAILS:										
PREFIX	VOLUME	FOLIO	OTHER	PARCEL	NUMBER	PLAN	NUMBER	HUNDRED / IA / DIVISION	TOWN	REFERENCE NUMBER
CT	5689	927		ALLOTMENT(S)	50	D	51338	BRIGHT		SECTION 8N
CT	5689	928		ALLOTMENT(S)	51	D	51338	BRIGHT		SECTION 8N
OTHER TITLES AFFECTED:										

EASEMENT DETAILS:										
STATUS	LAND BURDENED	FORM	CATEGORY	IDENTIFIER	PURPOSE	IN FAVOUR OF				CREATION
EXISTING	302	LONG	EASEMENT(S)	A		TRANSMISSION LESSOR CORPORATION OF 1 UNDIVIDED 2ND PART (SUBJECT TO LEASE 9061500) AND ELECTRANET PTY. LTD. OF 1 UNDIVIDED 2ND PART				T 3030798
EXISTING	301. 302	LONG	EASEMENT(S)	B		TRANSMISSION LESSOR CORPORATION OF 1 UNDIVIDED 2ND PART (SUBJECT TO LEASE 9061500) AND ELECTRANET PTY. LTD. OF 1 UNDIVIDED 2ND PART				T 5085252
EXISTING	301. 302	LONG	EASEMENT(S)	C		DISTRIBUTION LESSOR CORPORATION (SUBJECT TO LEASE 8890000)				T 5276850

ANNOTATIONS:	NO OCCUPATION ON SUBJECT LAND BOUNDARIES UNLESS SHOWN OTHERWISE									
--------------	---	--	--	--	--	--	--	--	--	--

D120572

SHEET 2 OF 3

65154\_pland\_1\_V04\_Version\_5

BEARING DATUM: MGA 94 ZONE 54

DERIVATION: GNSS OBS

TOTAL AREA:


REFERENCE MARKS

CNR	BEARING	FROM	DIST	PM NO
3	358°43'	PM FD	19.74	6730/1392
4	165°58'	PM FD	21.11	6730/1418
5	190°04'	PM FD	1.02	6730/1417
6	218°18'	PM FD	0.99	6730/1416
7	358°41'	PM FD	0.25	6730/1297
8	358°15'	PM FD	0.45	6730/1296
11	2°26'30"	MP	0.78	
12	338°18'	MP	0.91	
13	330°22'	MP	1.17	
14	7°10'	MP	1.36	
15	176°52'50"	MP	36.23	
17	207°34'	MP	1.38	

FIRST FIX

ENLARGEMENT A2

NOT TO SCALE

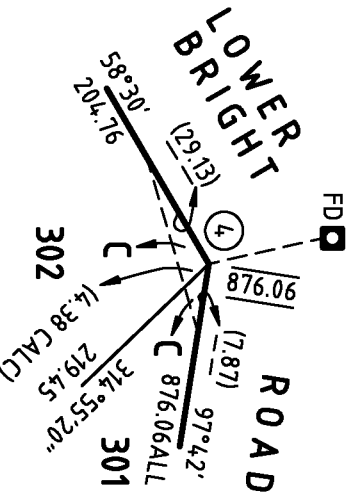

Alexander & Symonds Pty.Ltd.


11 KING WILLIAM STREET, KENT TOWN

P.O. BOX 1000 KENT TOWN 5071

Tel (08) 8130 1666 Fax (08) 8362 0099 A.B.N. 93 007 753 988

REFERENCE A064518LTO(A)

PAP 01/ 11/2018






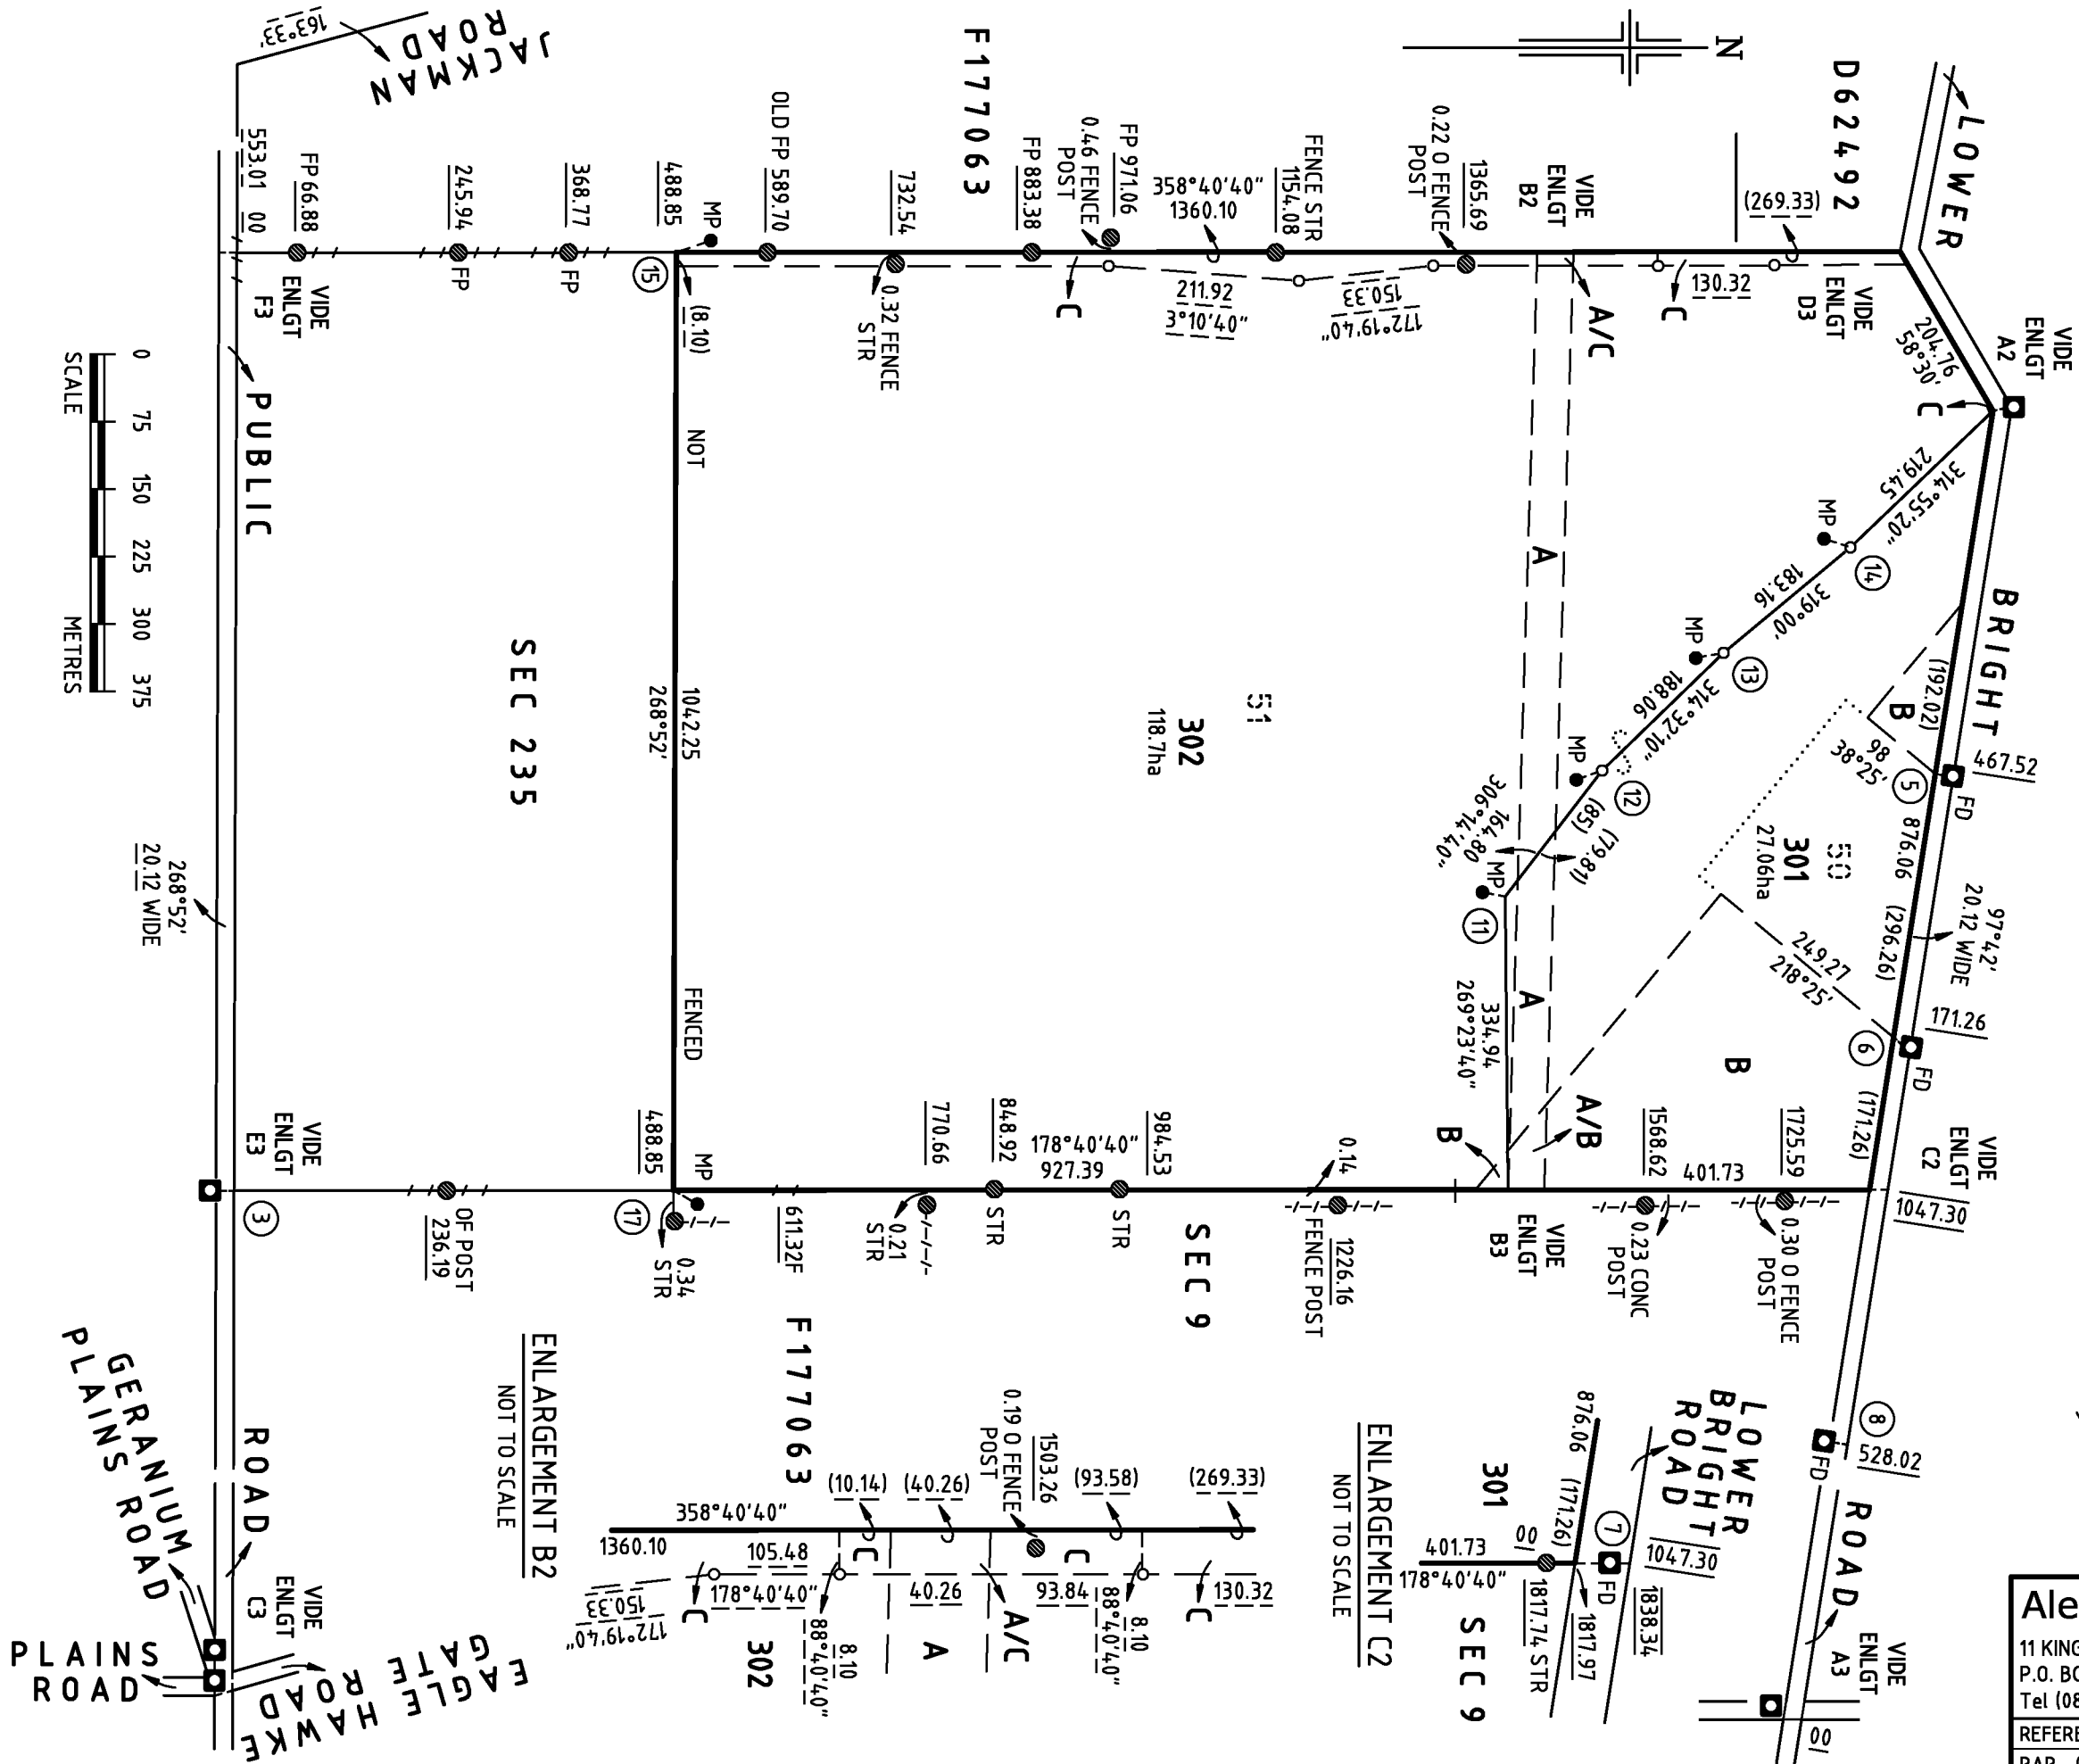


REFERENCE MARKS				
CNR	BEARING	FROM	DIST	PM NO
1	88°52'	PM FD	1.01	6730/1099
1	89°23'20"	PM FD	66.44	6730/1450
3	358°43'	PM FD	19.74	6730/1392
9	97°42'	PM FD	1.00	6730/1098
10	188°34'	MP	1.55	
16	73°34'	MP	5.53	

Diagram illustrating a survey section with various points and distances:

- LOWER BRIGHT ROAD** (top left)
- ST POLE**  $\underline{1848.95}$
- STR**  $\underline{1844.07}$
- OF POST**  $\underline{1785.69}$
- D 6 2 4 9 2** (middle left)
- ARGUMENT D3** (bottom left)
- NOT TO SCALE** (bottom left)
- F 1 7 7 0 6 3** (bottom left)
- 302** (middle right)
- C** (middle right)
- Distances and Angles:**
  - $142.92$
  - $179^{\circ}25'$
  - $358^{\circ}40'40''$
  - $(269.33)$
  - $0.12$
  - $\underline{1672.41}$
  - $\underline{130.32}$
  - $204.76$
  - $58^{\circ}30'$
  - $(7.77)$

65154\_pland\_2\_V04\_Version\_5

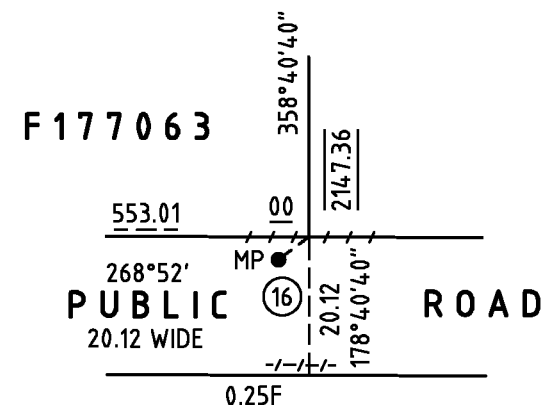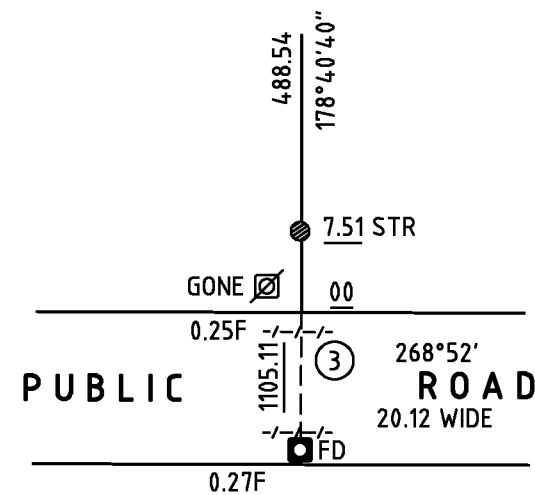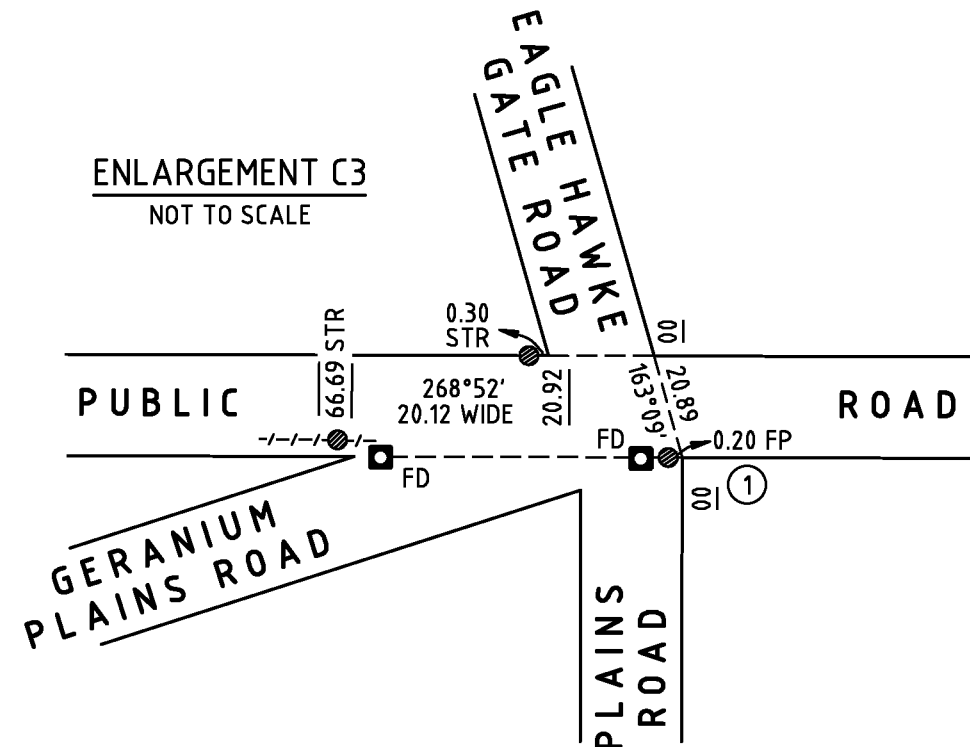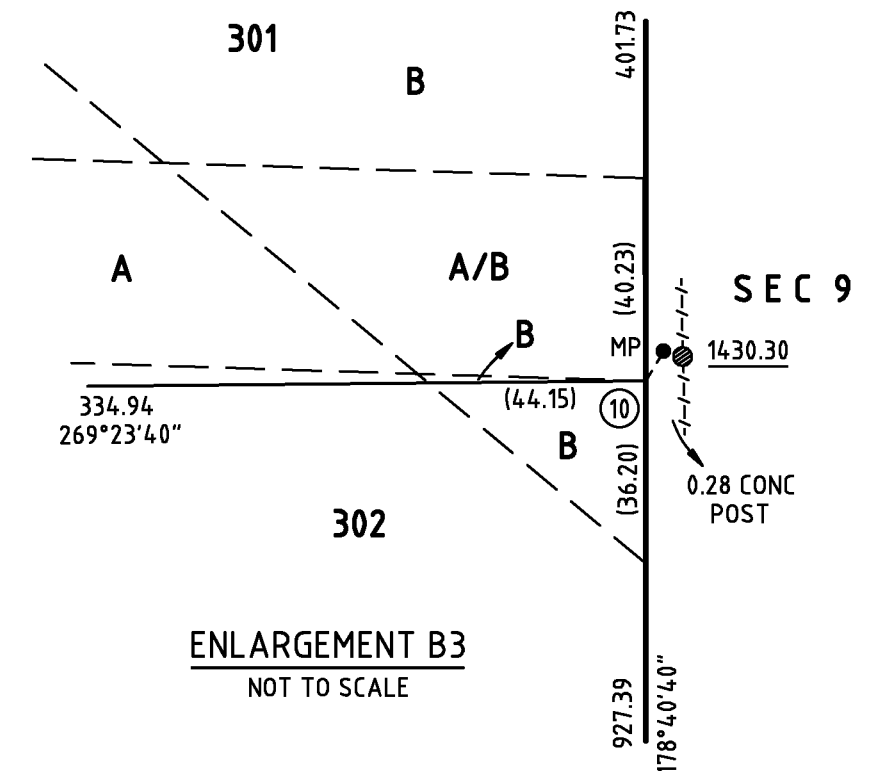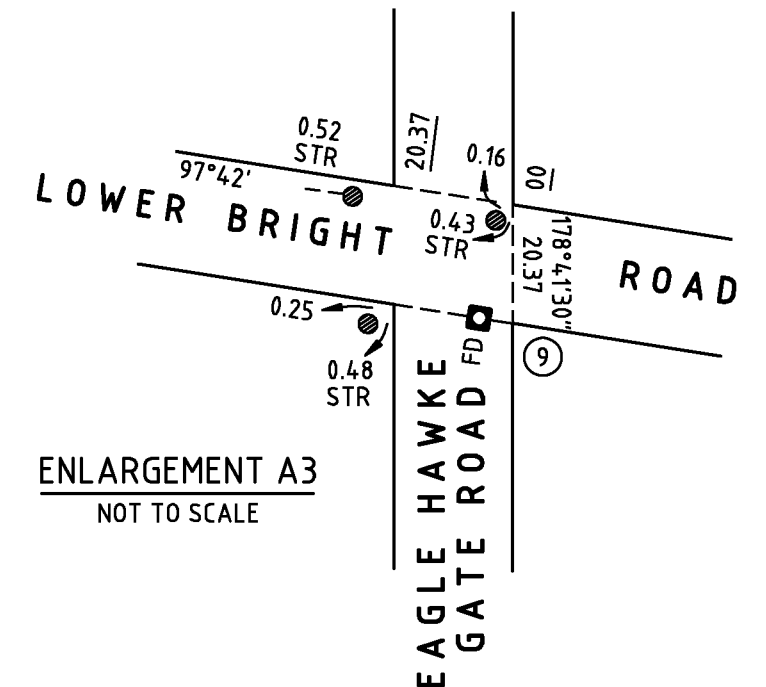

ALEXANDER & SYMONDS PTY LTD (ALSY)  
POST OFFICE BOX 1000  
KENT TOWN  
SA 5067

LTO BOX 118

25 February 2019

## CONFIRMATION OF PLAN APPROVAL

**Plan Reference:** D120572  
**Job ID:** 65154  
**Agent Reference:** A064518LTO(A)  
**Lodgement Date:** 29/01/2019  
**Title Details:** CT 5689/927  
CT 5689/928  
**Registered Proprietor/s:** JOHN ROBERT LIPSCHINSKI  
TRANSMISSION LESSOR CORPORATION  
**Location:** 192 LOWER BRIGHT ROAD, BRIGHT, SA 5381  
**Approval Date:** 25/02/2019

**Requirements to be fulfilled or Complied with:**

The deposit of the plan and subsequent issue of new Certificates of Title may depend on the lodgement of further documentation in a registrable form.




**Brenton Pike**

**Chief Executive Officer**

**Land Services SA**


*Land Services SA acting under delegation of the Registrar-General pursuant to section 17 of the Real Property Act 1886 (SA).*

## Appendix B Substation Drawings

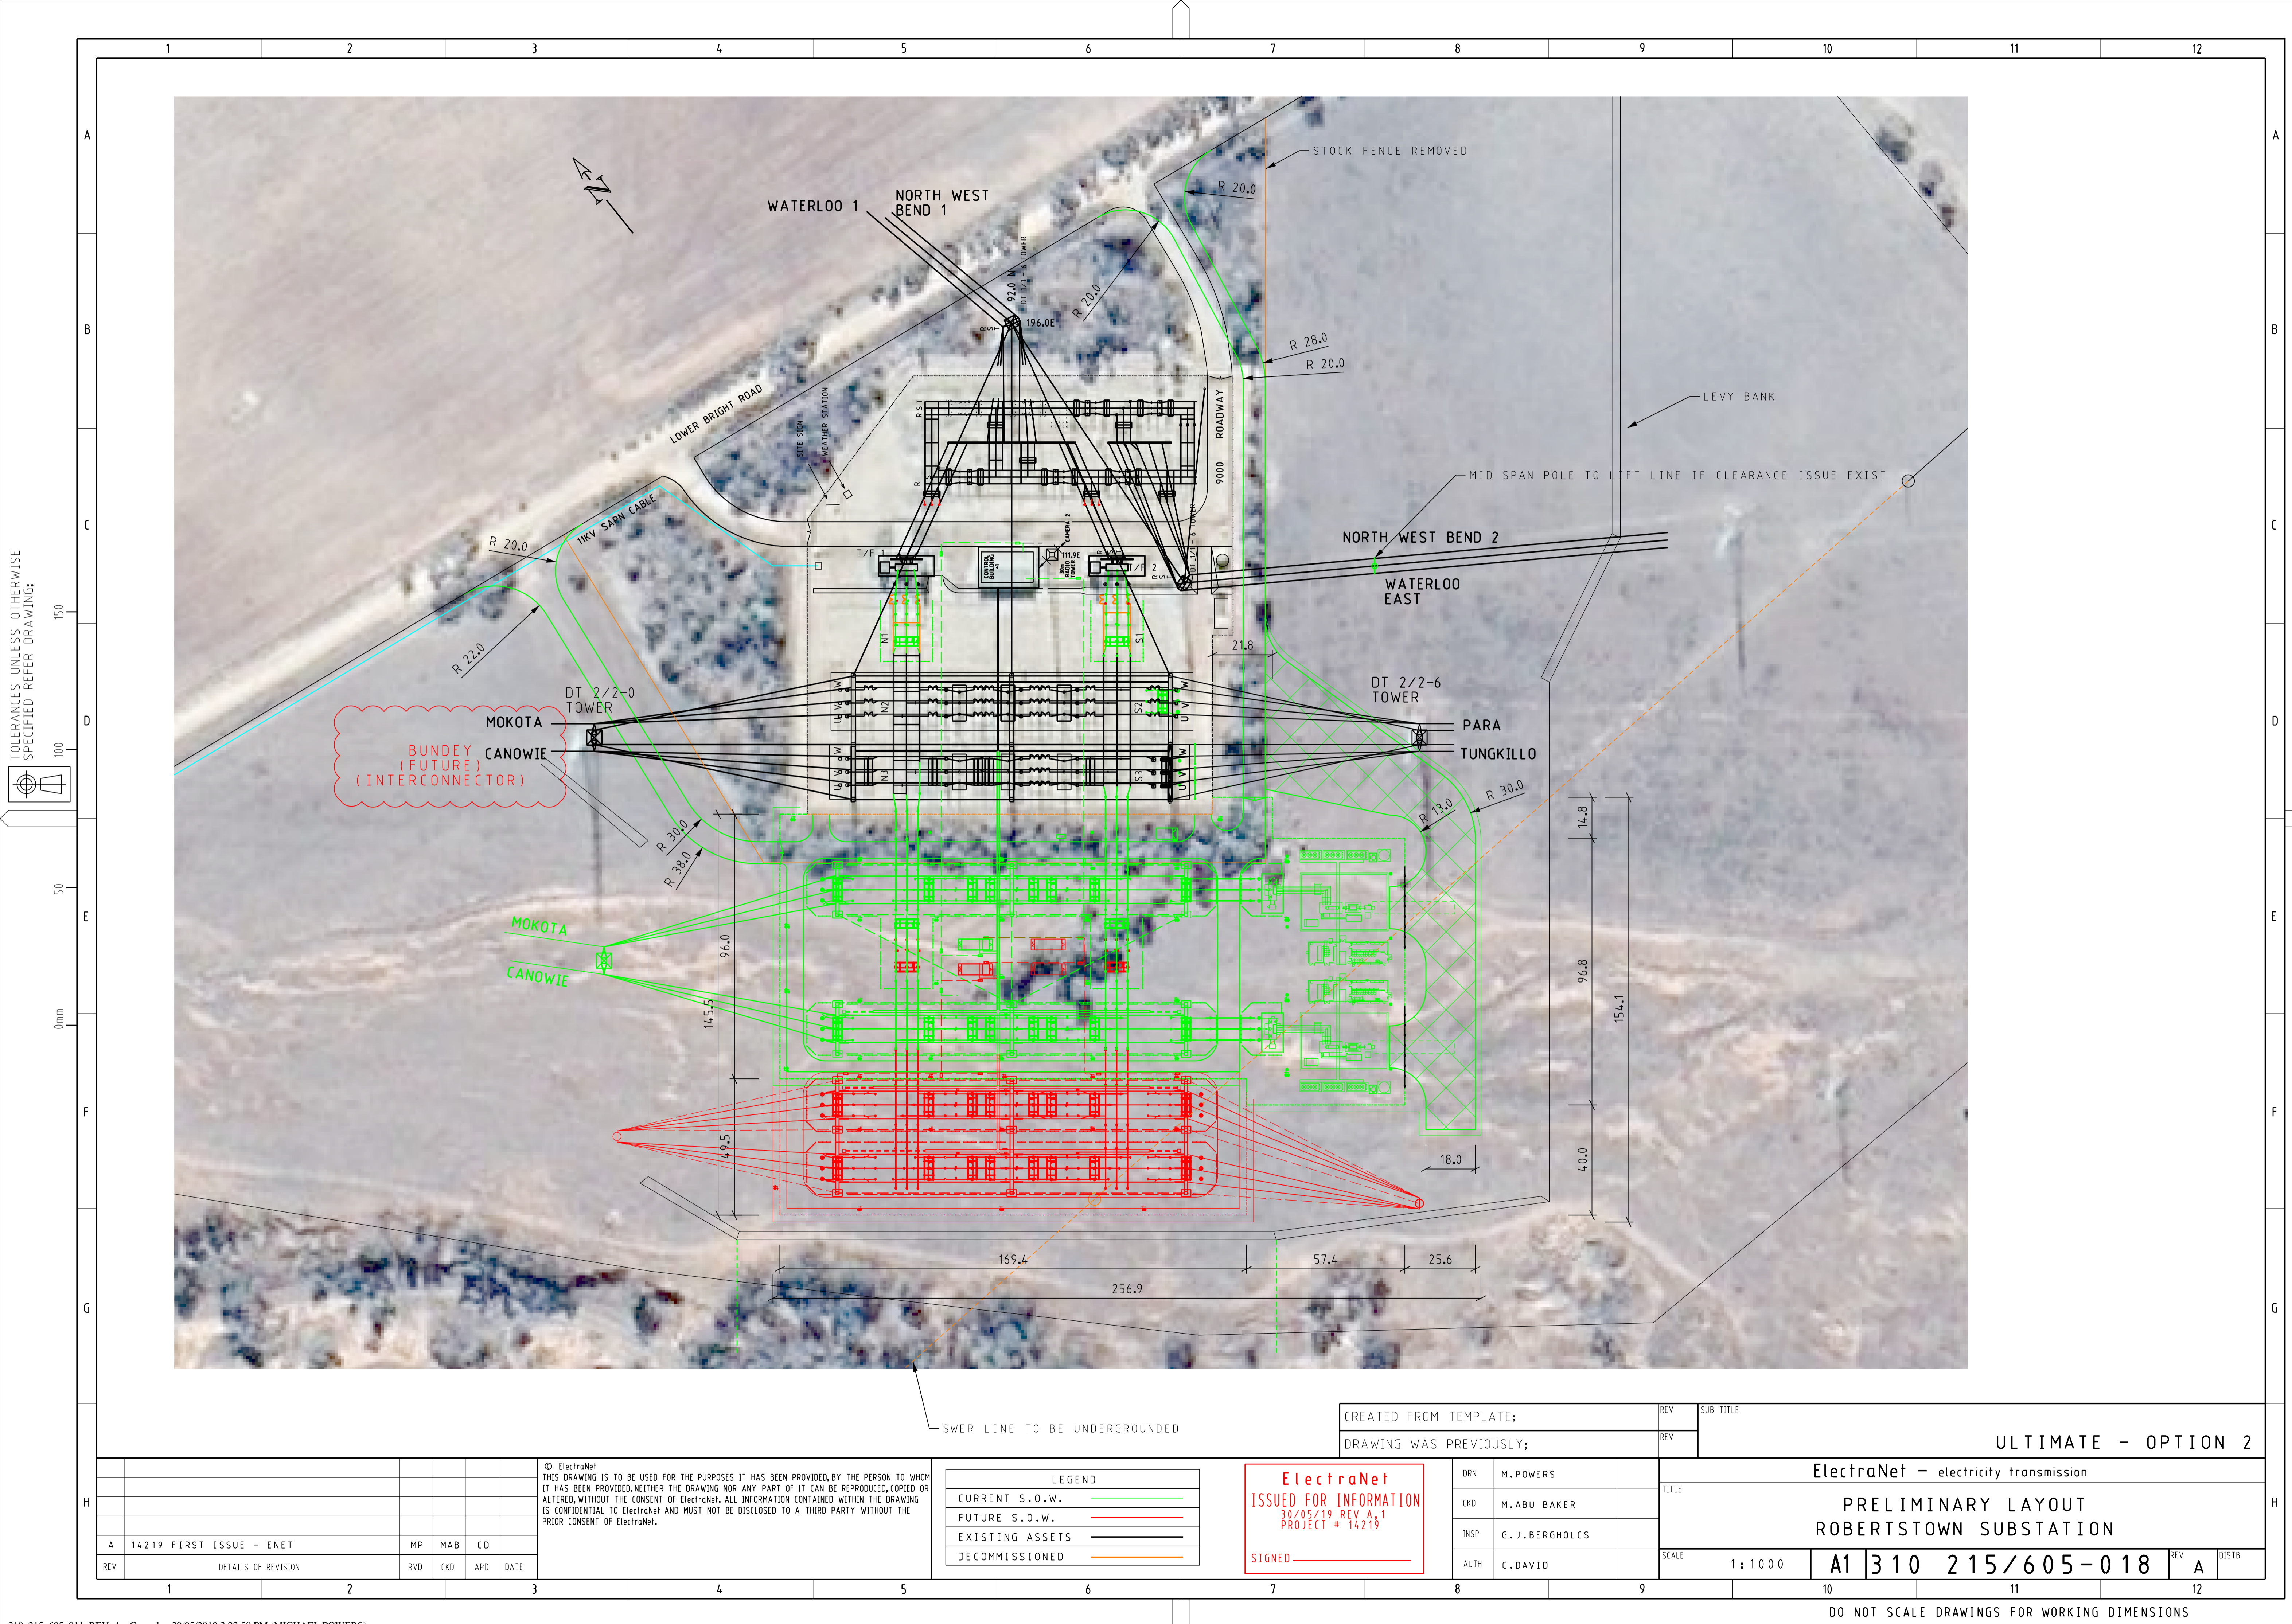



TOLERANCES - UNLESS OTHERWISE SPECIFIED REFER DRAWING:




150

100

50


0mm

= C 05  
/ 608-012

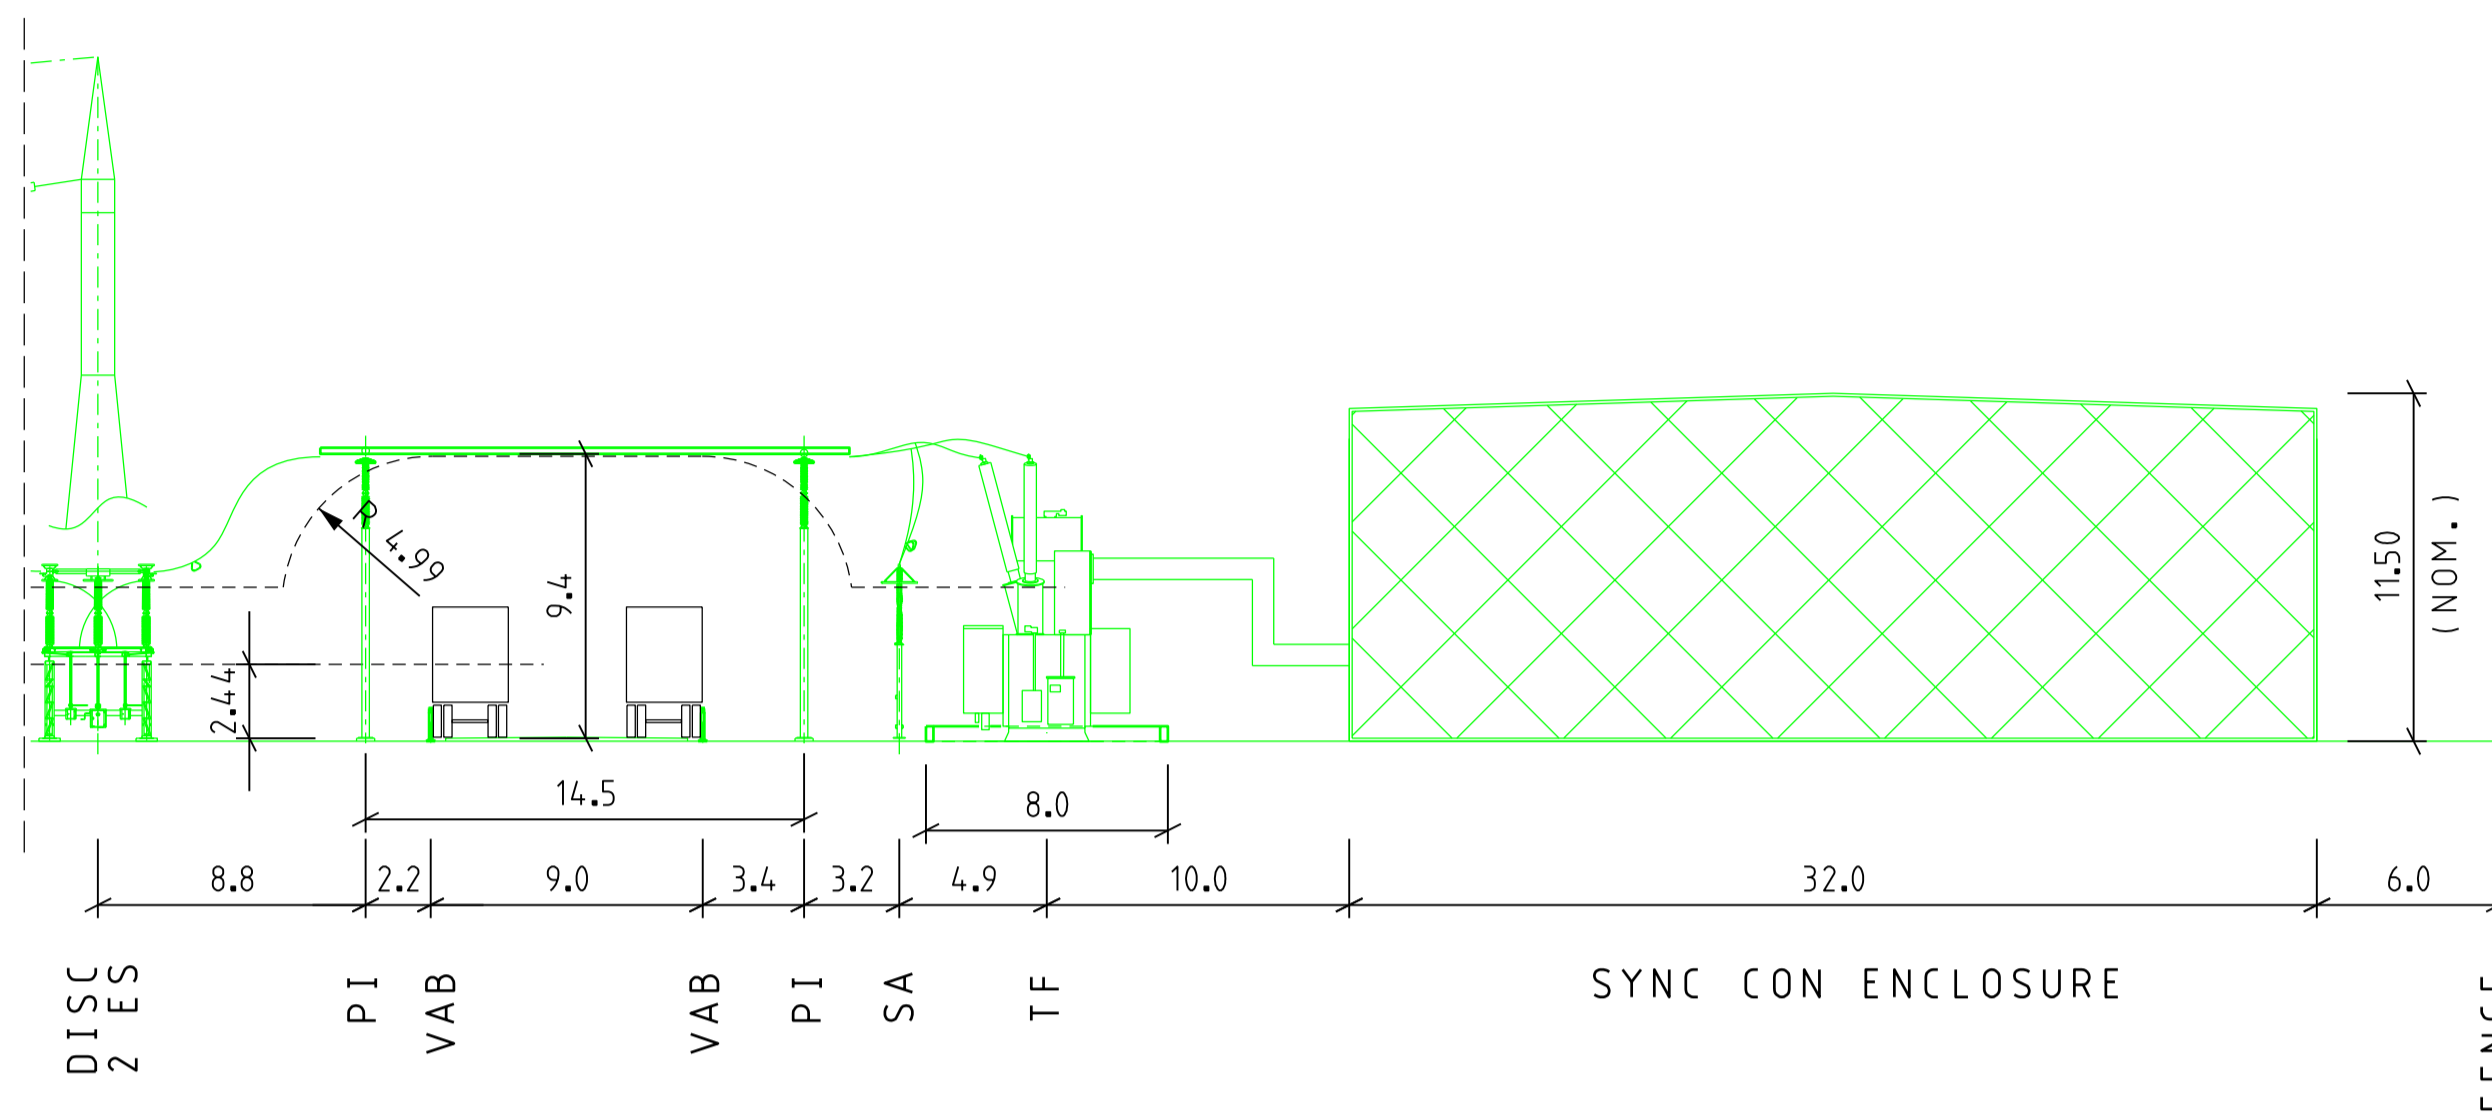

TRANSFORMER 3 AND SYNCON 1 AREA

= C 07  
/ 608-012

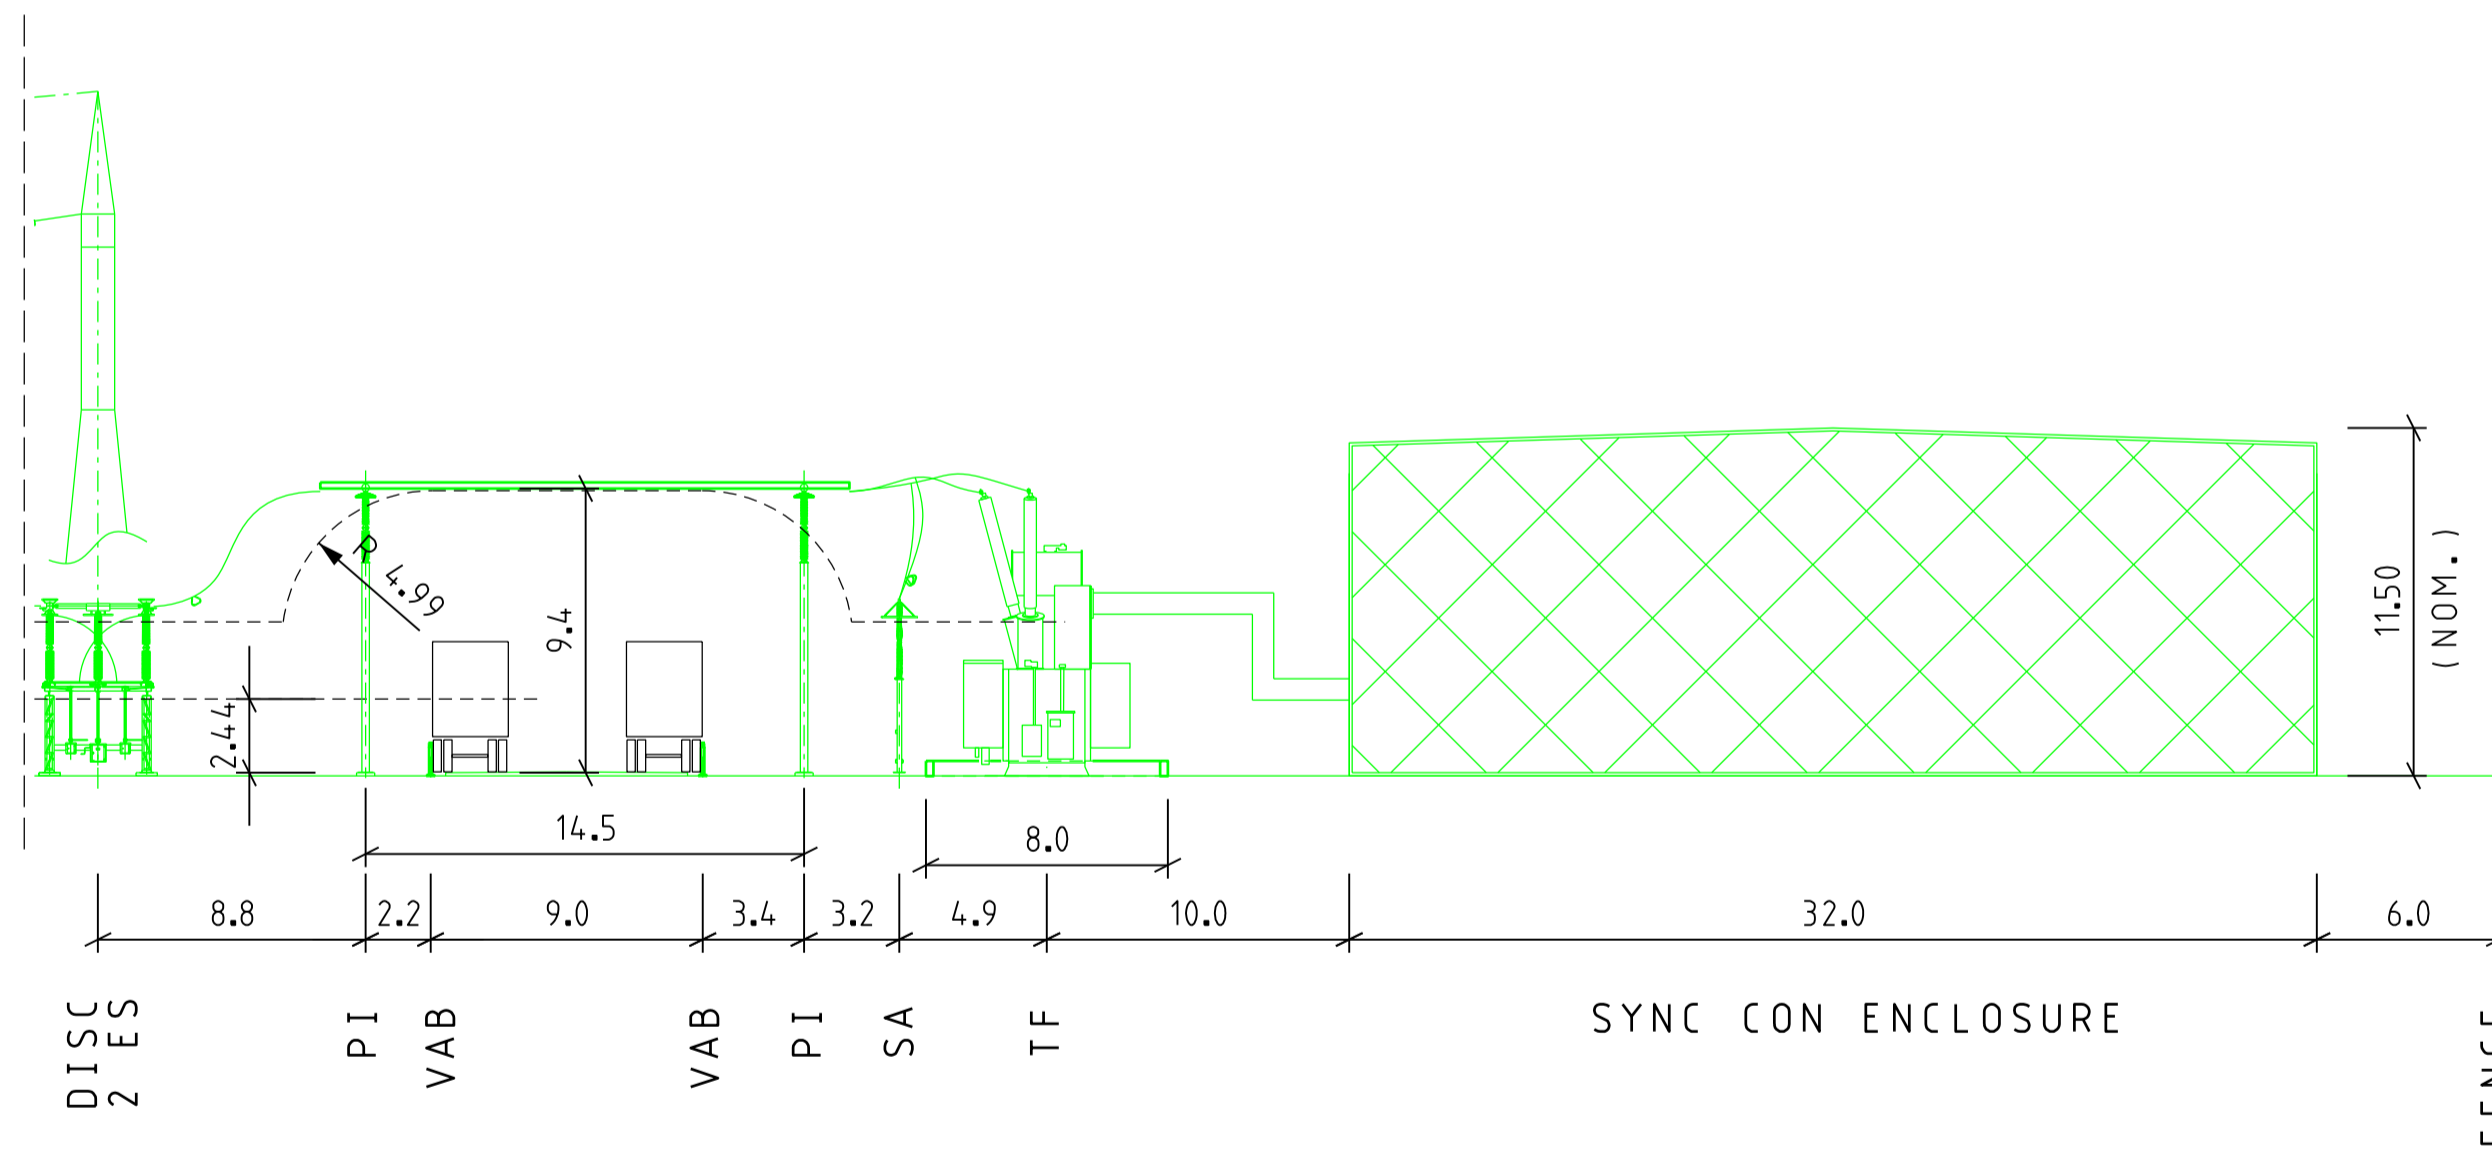

TRANSFORMER 4 AND SYNCON 2 AREA

CREATED FROM TEMPLATE;		REV	SUB TITLE	
DRAWING WAS PREVIOUSLY;		REV	TRANSFORMER 3 & 4 AND SYNCHRONOUS CONDENSERS 1 & 2 - OPTION 2	
DRN	M. POWERS		ElectraNet - electricity transmission	
CKD	M. ABU BAKER		PRELIMINARY ELEVATION SECTION	
INSP	G. J. BERGHOLCS		ROBERTSTOWN SUBSTATION	
AUTH	C. DAVID		SCALE	1:250
			A1	310 215/608-014
			REV	A
			DISTB	

REV	DETAILS OF REVISION	RVD	CKD	APD	DATE
A	14219 FIRST ISSUE - ENET	MP	MAB	CD	


© ElectraNet  
THIS DRAWING IS TO BE USED FOR THE PURPOSES IT HAS BEEN PROVIDED BY THE PERSON TO WHOM IT HAS BEEN PROVIDED. NEITHER THE DRAWING NOR ANY PART OF IT CAN BE REPRODUCED, COPIED OR ALTERED, WITHOUT THE CONSENT OF ElectraNet. ALL INFORMATION CONTAINED WITHIN THE DRAWING IS CONFIDENTIAL TO ElectraNet AND MUST NOT BE DISCLOSED TO A THIRD PARTY WITHOUT THE PRIOR CONSENT OF ElectraNet.

LEGEND	
CURRENT S.O.W.	—
FUTURE S.O.W.	—
EXISTING ASSETS	—
DECOMMISSION	—

**ElectraNet**  
ISSUED FOR INFORMATION  
31/05/19 REV A.1  
PROJECT # 14219  
SIGNED \_\_\_\_\_

## Appendix C Transmission Line Drawings

TOLERANCES UNLESS OTHERWISE SPECIFIED REFER DRAWING



NOTES:

1. TERMINATE OPGW END AT STR-0466, STR-0471 AND ROBERTSTOWN GANTRIES WITH OPGW STORAGE COIL, DOWNLEAD CLAMPS AND JOINT BOX. INSTALL VERTICAL STORAGE COIL AT STR-0471 WITHOUT JOINT BOX.
2. DECOMMISSIONING:
  - SPAN (OHEW): STR-0471 TO STR-0473
  - SPAN (COND): STR-0472 TO STR-0473
  - TOWER: STR-0472
3. LEAVE AS IS FOR INTERCONNECTOR PROJECT EC.14171:
  - STR-0473
  - SPAN (COND & OHEW): STR-0473 TO GANTRIES




© ElectraNet  
THIS DRAWING IS TO BE USED FOR THE PURPOSES IT HAS BEEN PROVIDED BY THE PERSON TO WHOM IT HAS BEEN PROVIDED. NEITHER THE DRAWING NOR ANY PART OF IT CAN BE REPRODUCED, COPIED OR ALTERED, WITHOUT THE CONSENT OF ElectraNet. ALL INFORMATION CONTAINED WITHIN THE DRAWING IS CONFIDENTIAL TO ElectraNet AND MUST NOT BE DISCLOSED TO A THIRD PARTY WITHOUT THE PRIOR CONSENT OF ElectraNet.

LEGEND	
CURRENT S.O.W.	—
FUTURE S.O.W.	—
EXISTING ASSETS	—
DECOMMISSIONED	—

**ElectraNet**  
ISSUED FOR INFORMATION  
20/05/19 REV. A.1  
PROJECT # 14219  
SIGNED \_\_\_\_\_

DRN	M. POWERS
CKD	J. DAVIS
INSP	J. McCORMACK
AUTH	C. DAVID

REV	SUB TITLE												
REV													
ElectraNet - electricity transmission													
TITLE PROPOSED LINE ROUTE CORRIDOR ROBERTSTOWN - MOKOTA & CANOWIE													
SCALE		1 : 2 5 0 0								A1 3 0 2 1 3 4 / 5 0 0 - 0 0 1	REV	A	DISTB

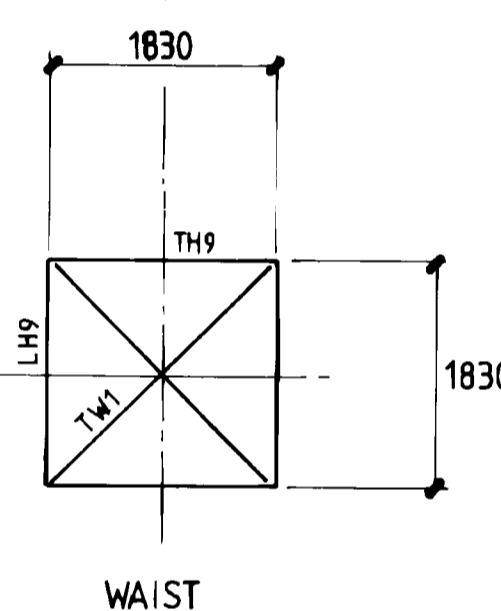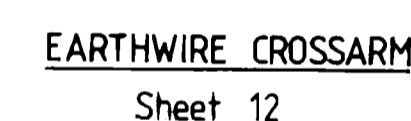

UNREDUCED SCALE 1:60

THE ELECTRICITY TRUST OF SOUTH AUSTRALIA  
275KV TRANSMISSION LINES  
DOUBLE CIRCUIT SUSPENSION TOWER  
TYPE DS 2/7  
OUTLINE +6 TOWER

SCALE 1:60

B1-08675	1
----------	---